



**NOTES:**

- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.
- 4. CONNECTION PIPE SIZE IS 1 1/8 [29.00] DIAMETER FOR 7 & 9 TON. CONNECTION PIPE SIZE IS 1 5/8 [41.00] DIAMETER FOR 11 & 13 TON.
- 5. ALL DIMENSIONS ARE IN INCH [mm] FORMAT.
- 6. FOR THE 13 TON UNIT, THE ELECTRICAL BOX IS RELOCATED TO BELOW THE COIL SHELF.

| REVISIONS |                        |          |     |
|-----------|------------------------|----------|-----|
| REV       | DESCRIPTION            | DATE     | BY  |
| L         | UPDATED PIPING DETAILS | 03-17-15 | RRK |

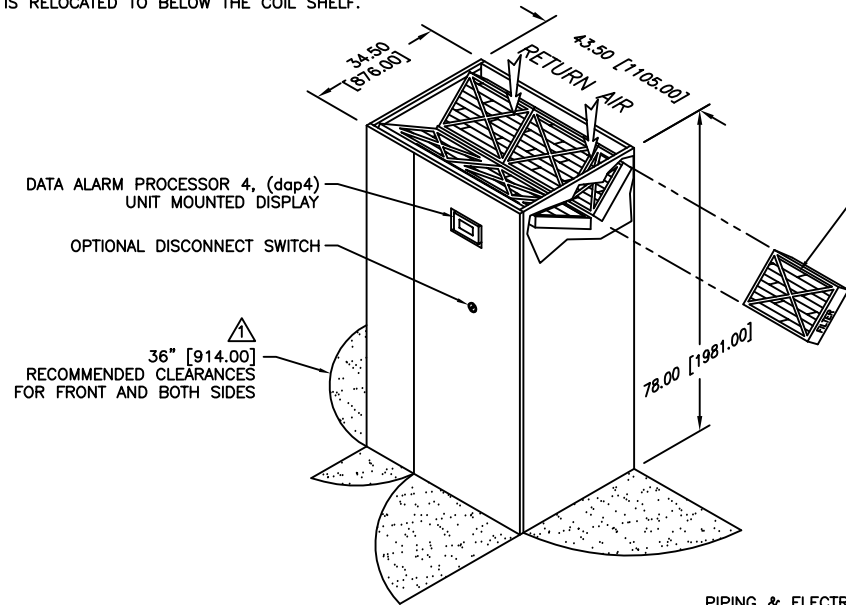


**DIMENSIONAL DATA**

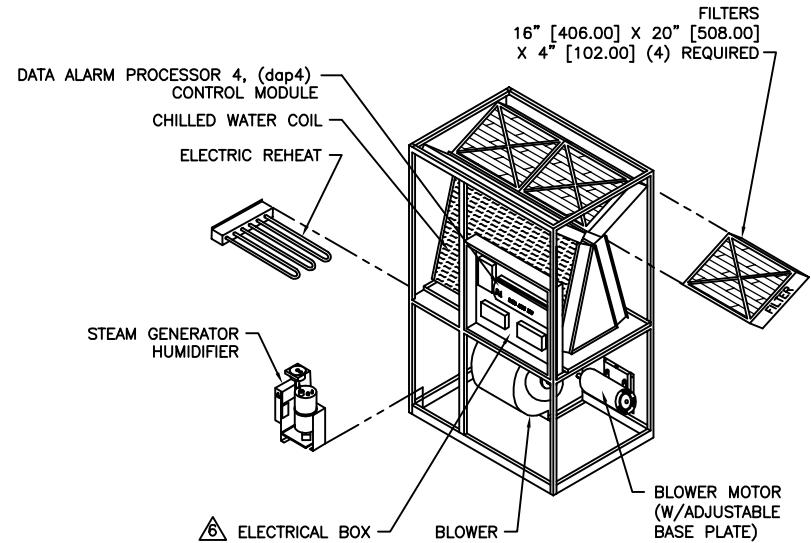

FILTERS MAY BE  
ACCESSED FROM  
THE TOP OF  
UNIT OR FROM  
EITHER SIDE

**COMPONENT BREAKDOWN**

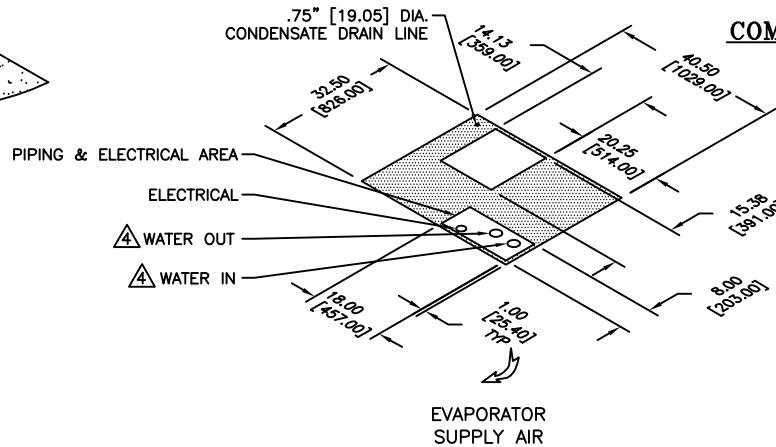

**FLOOR CUTOUT DIMENSIONS**

|  |          |             |
|--|----------|-------------|
| DATA AIRE<br>7, 9, 11 & 13 TON<br>DOWNFLOW CHILLED WATER |          |             |
|  |          |             |
| DRAWN BY :   | E. DIAZ  | SCALE: NONE |
| CHECKED BY :   |          | SH 1 OF 1   |
| DATE :   | 07-22-04 | REV    L    |
| PART OF  |          |             |
| <b>550-900-058</b>                                       |          |             |
| DWG NO.  |          |             |