


NOTES:


- △ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

UNIT (KW)	CONNECTION PIPE SIZE (ø)							
	07		11		14		18	
LIQUID	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]
HOT GAS	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]
WATER IN	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
WATER OUT	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
AUX. CW IN	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
AUX. CW OUT	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]


REVISIONS			
REV	DESCRIPTION	DATE	BY
G	UPDATED PIPING DETAILS	11-20-15	RRK

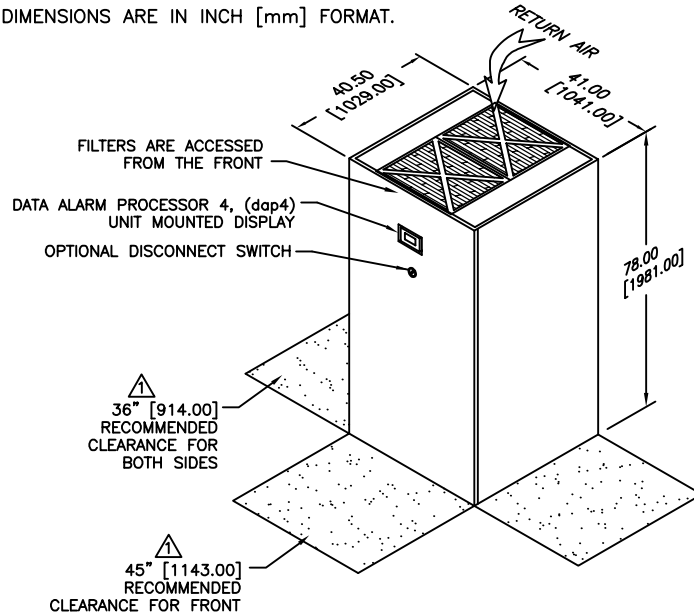

DIMENSIONAL DATA

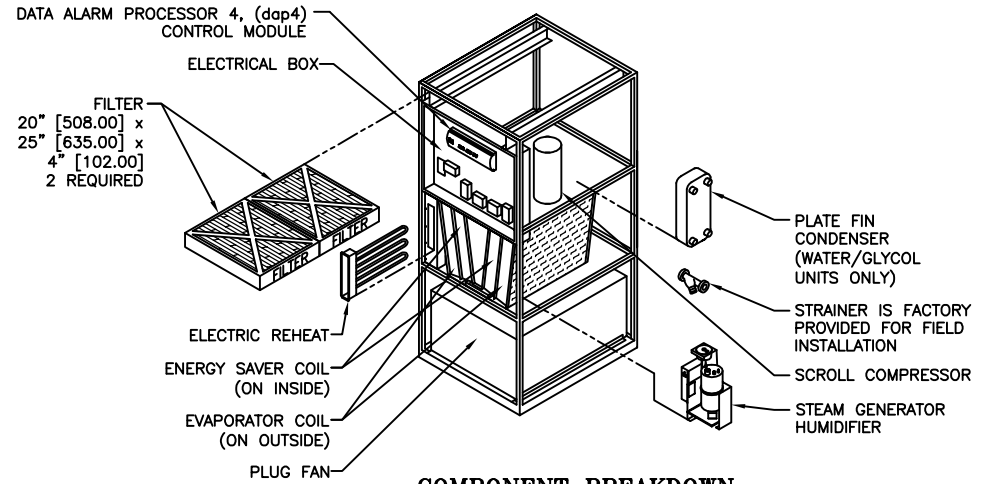

COMPONENT BREAKDOWN

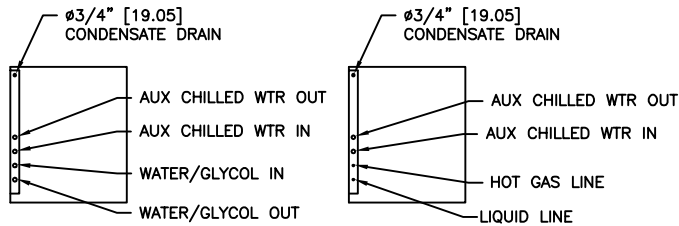


WATER/GLYCOL COOLED

AIR COOLED

STANDARD PIPING LOCATIONS

(SEE CONNECTION PIPE SIZE CHART)

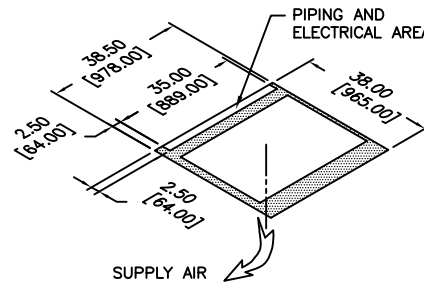

BOTTOM PANEL LAYOUT DIMENSIONS

gForce GT 7, 11, 14 & 18 KW
DX DOWNFLOW, V-TYPE COIL
WITH ENERGY SAVER COIL

dataaire

DRAWN BY :	GABE	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	06-14-10	REV G

PART OF

560-900-005

DWG NO.