


NOTES:


- 1. Δ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

UNIT (kW)	CONNECTION PIPE SIZE (Ø)							
	07		11		14		18	
LIQUID	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]
HOT GAS	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]
WATER IN	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
WATER OUT	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
AUX. CW IN	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]
AUX. CW OUT	3/4	[19.05]	3/4	[19.05]	1-1/8	[29.00]	1-1/8	[29.00]

REVISIONS			
REV	DESCRIPTION	DATE	BY
J	UPDATED PIPING DETAILS	11-23-15	RRK

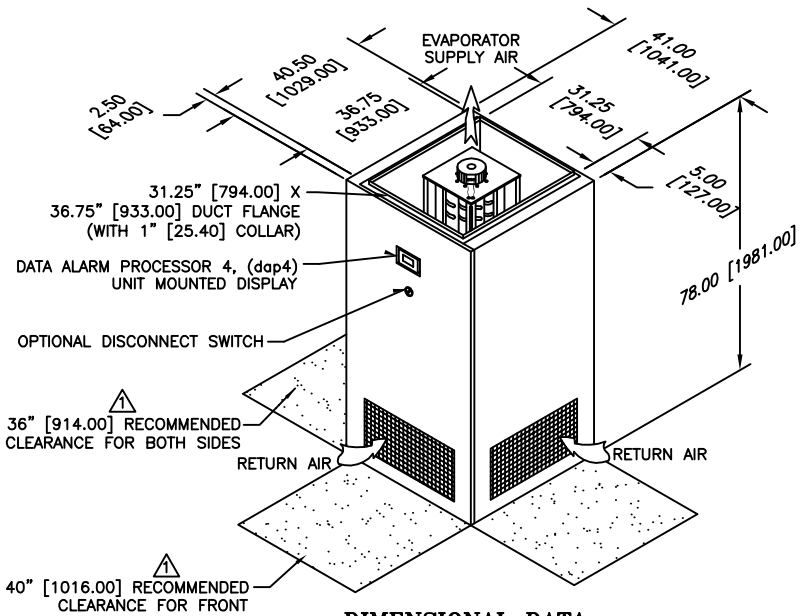

DIMENSIONAL DATA

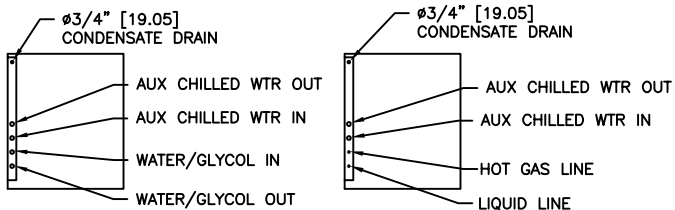


WATER/GLYCOL COOLED


AIR COOLED

STANDARD PIPING LOCATIONS

(SEE CONNECTION PIPE SIZE CHART)

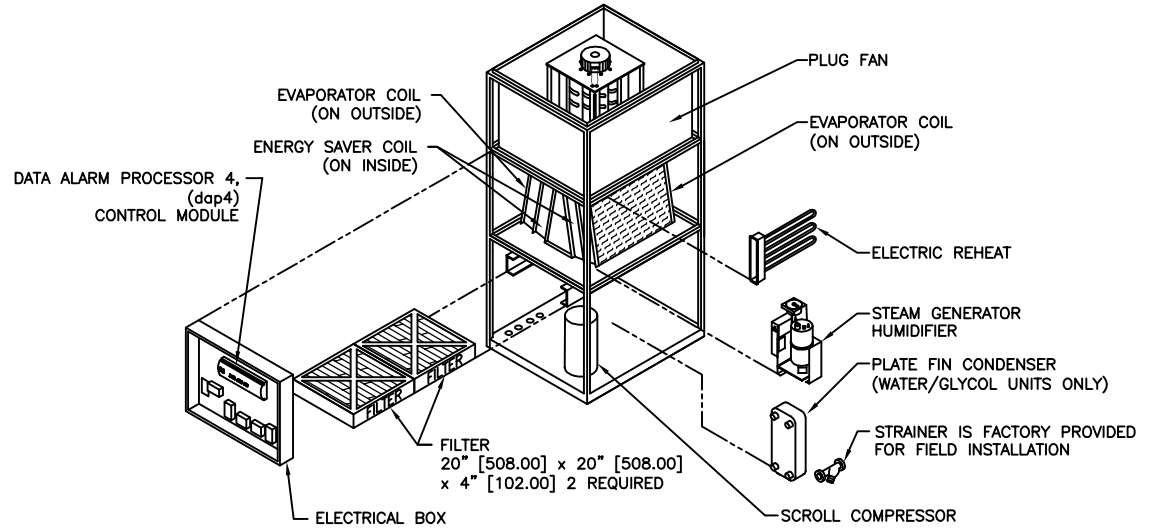

COMPONENT BREAKDOWN

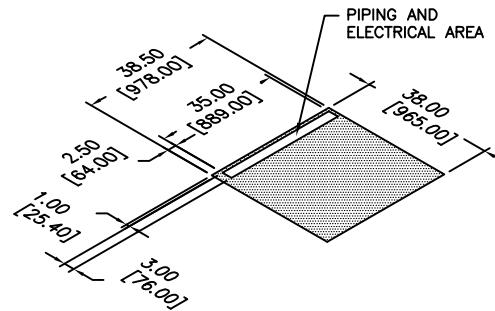

BOTTOM PANEL LAYOUT DIMENSIONS

gForce GT 7, 11, 14 & 18 KW
DX UPFLOW, A-TYPE COIL
WITH ENERGY SAVER COIL



DRAWN BY :	GABE	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	06-16-10	REV J

PART OF

560-900-006
DWG NO.