


NOTES:


- ⚠ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- ⚠ CONNECTION PIPE SIZE IS 1 5/8 [41.00] DIAMETER FOR 53 KW. CONNECTION PIPE SIZE IS 2 1/8 [54.00] DIAMETER FOR 63, 77 & 91 KW.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

DIM 'A'	
78.00"	[1981.00] WITH 3KW FAN
84.00"	[2134.00] WITH 5KW FAN


REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
E	UPDATED NOTES & TITLEBLOCK	03-19-15	RRK	GM

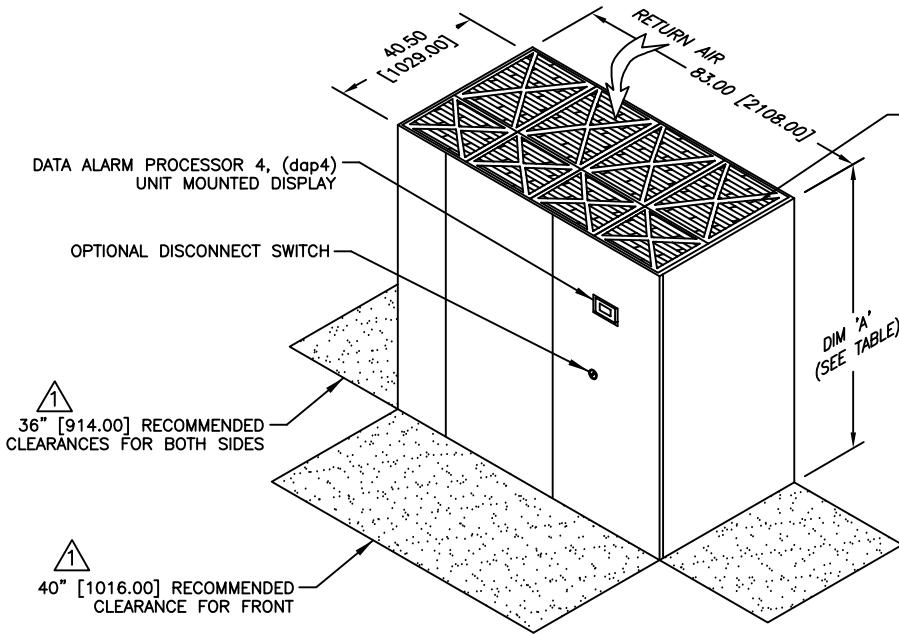


DIMENSIONAL DATA

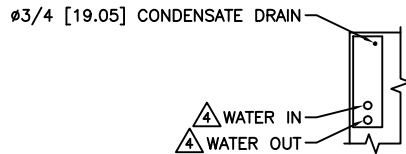

STANDARD PIPING LOCATIONS

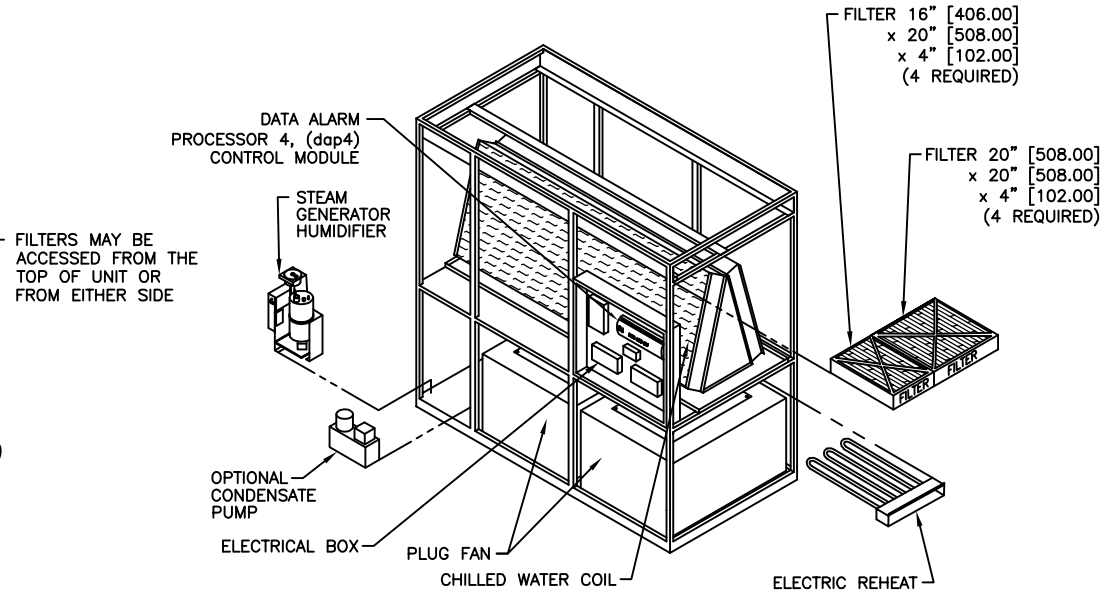

COMPONENT BREAKDOWN

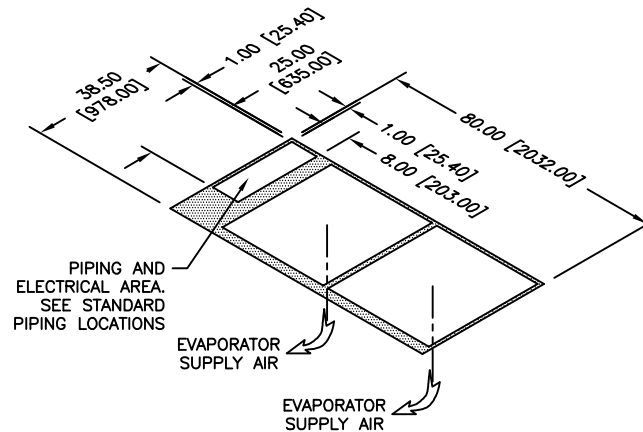

FLOOR CUTOUT DIMENSIONS

gForce GF
53, 63, 77 & 91 KW
CHILLED WATER DOWNFLOW

dataire

DRAWN BY : GABE		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE :	06-14-10	REV	E

PART OF
560-900-401
DWG NO.