


NOTES:


- △ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- CONNECTION PIPE SIZE IS 2 1/8 [54.00] DIAMETER.
- ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

DIM 'A'		
78.00	[1981.00]	WITH 3KW FAN
84.00	[2134.00]	WITH 5KW FAN


REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
H	RELOCATED HUMIDIFIER	12-04-15	RRK	T

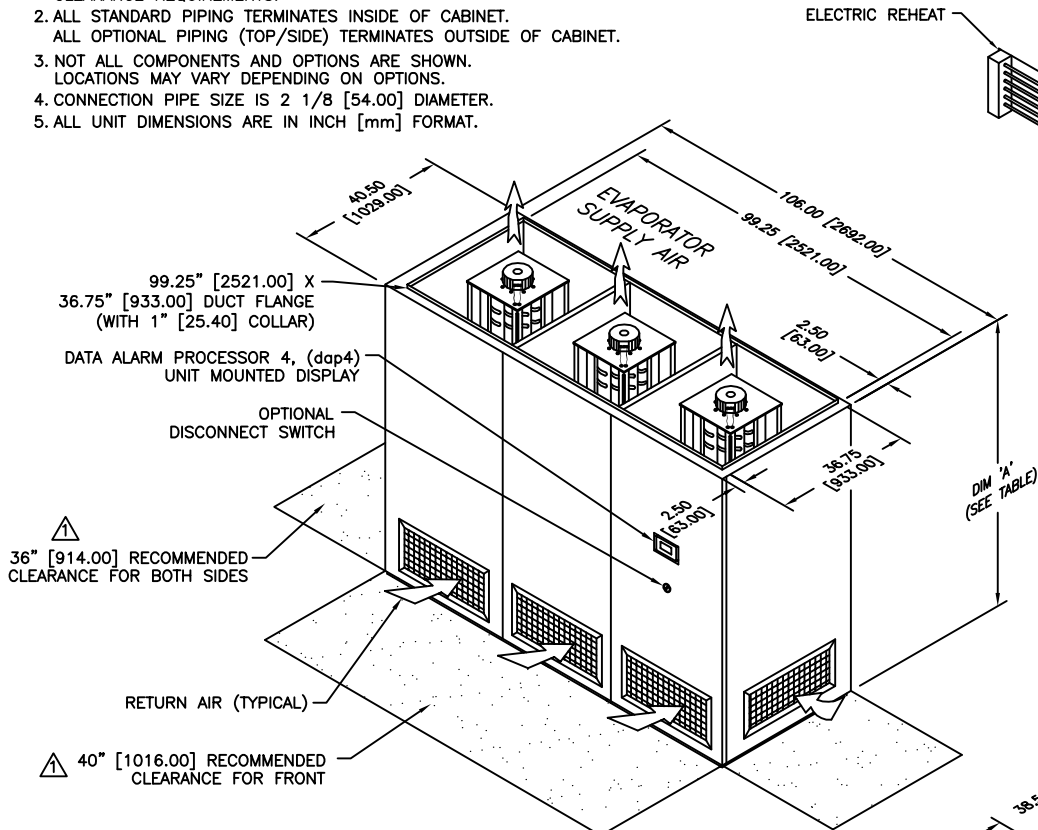


DIMENSIONAL DATA

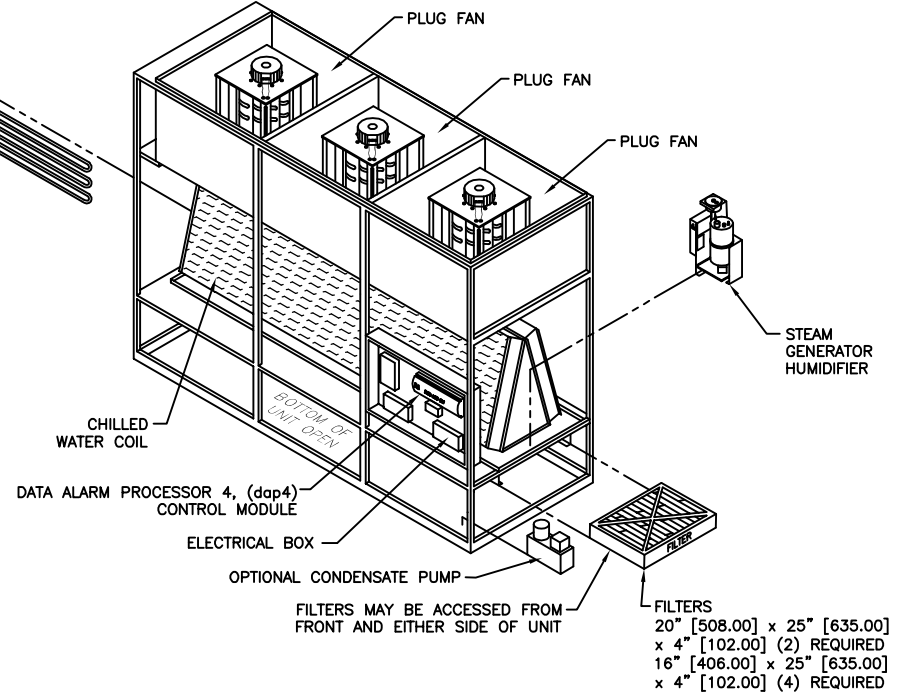

COMPONENT BREAKDOWN

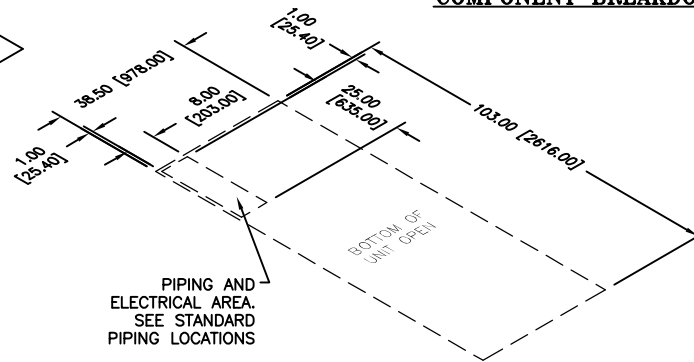

FRAME DIMENSIONS



STANDARD PIPING LOCATIONS

gForce GF 106 KW CHILLED WATER UPFLOW			
dataaire			
DRAWN BY : GABE		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE : 06-16-10	REV	H	
PART OF			
560-900-602			
DWG NO.			