



NOTES:

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
4. CONNECTION PIPE SIZE IS 2 5/8 [67.00] DIAMETER.
5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.


REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
E	UPDATED NOTES & TITLEBLOCK	03-20-15	RRK	GM

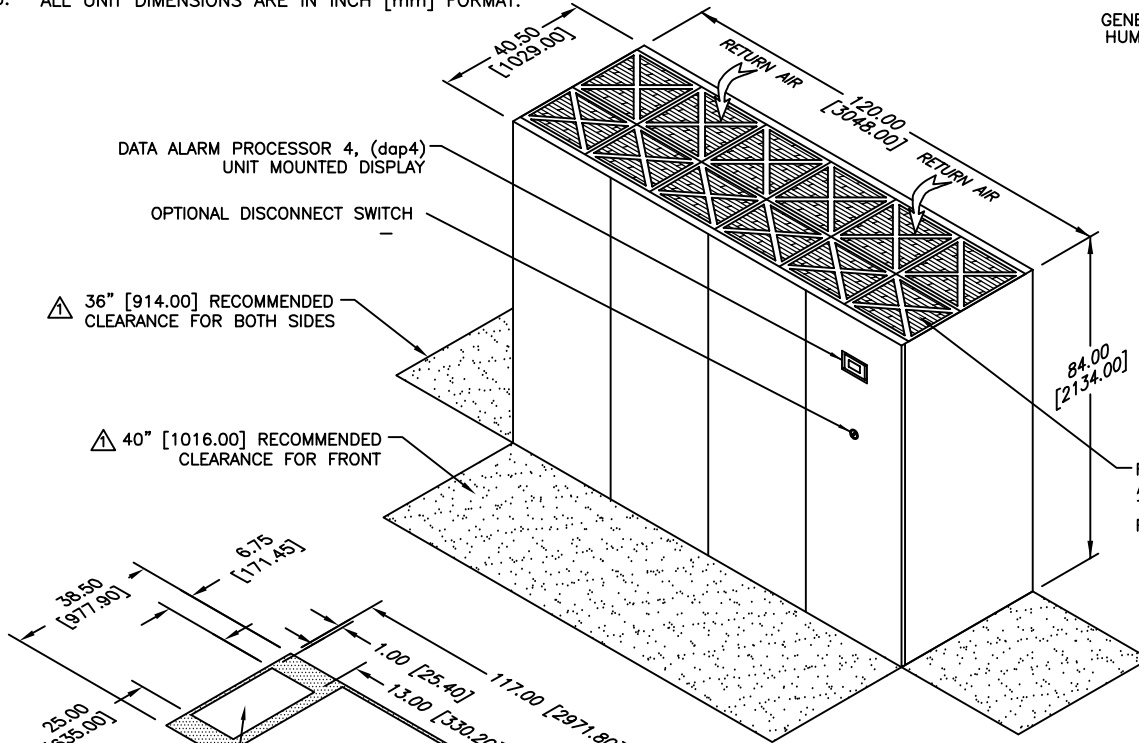


DIMENSIONAL DATA

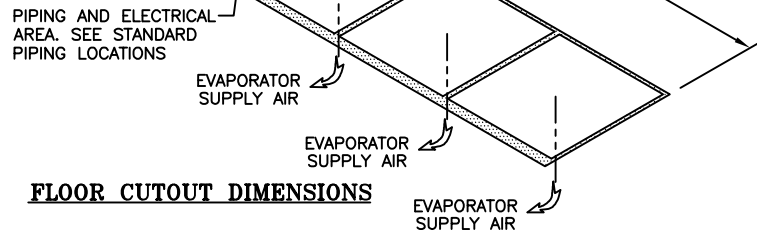

FLOOR CUTOUT DIMENSIONS

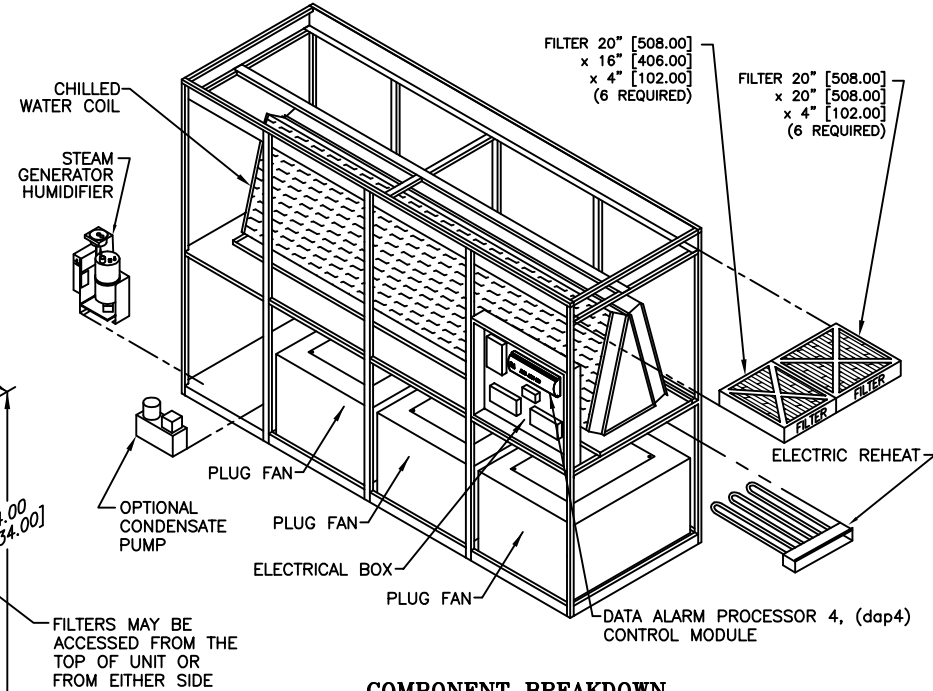

COMPONENT BREAKDOWN



STANDARD PIPING LOCATIONS

gForce GF
141, 158 & 176 KW
CHILLED WATER DOWNFLOW

dataaire

DRAWN BY : GABE		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE : 06-14-2010	REV	E	

PART OF

560-900-701
DWG NO.