



NOTES:

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
4. CONNECTION PIPE SIZE IS 2 5/8 [67.00] DIAMETER.
5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.


REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
J	UPDATED NOTES & TITLEBLOCK	03-20-15	RRK	DM

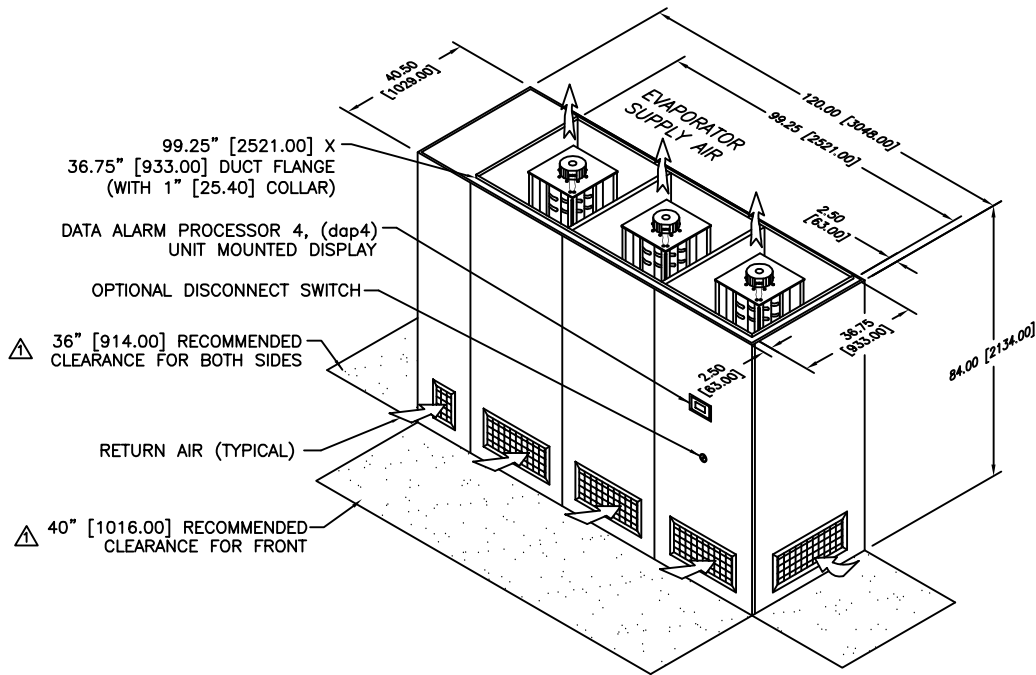


DIMENSIONAL DATA



STANDARD PIPING LOCATIONS

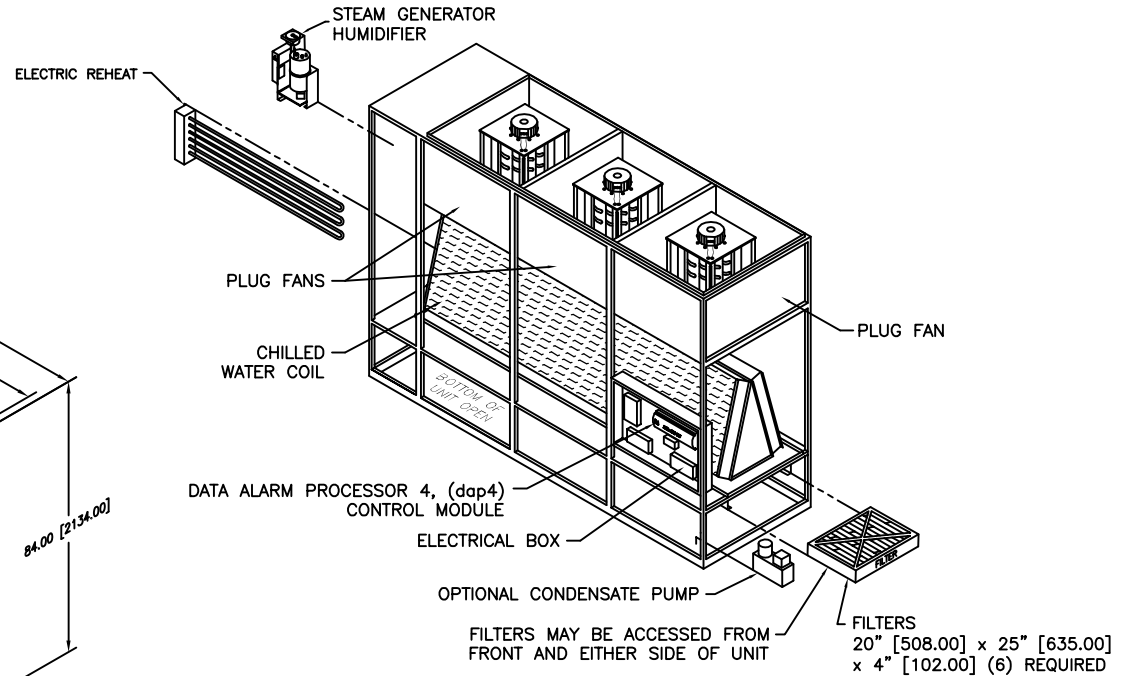

COMPONENT BREAKDOWN

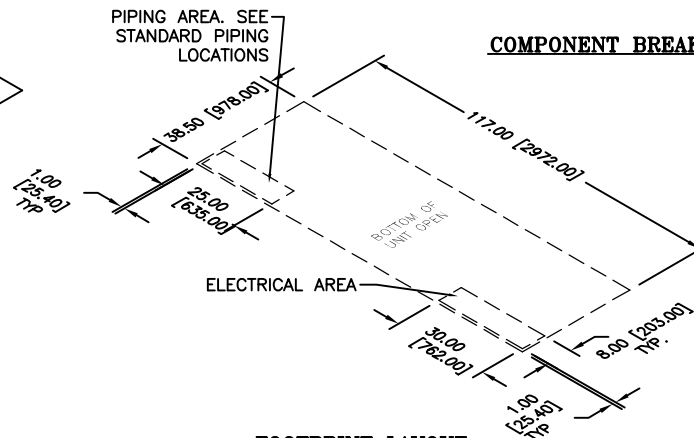

FOOTPRINT LAYOUT
(PIPING & ELECTRICAL AREA REFERENCE)

gForce GF 141, 158 & 176 KW CHILLED WATER UPFLOW			
dataaire			
DRAWN BY : GABE		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE : 06-16-10	REV	J	
PART OF			
560-900-702			
DWG NO.			