

NOTES:

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.


2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET.

ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.

3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.

4. CONNECTION PIPE SIZE IS 3.13 [79.00] DIAMETER.


5. ALL DIMENSIONS ARE IN INCH [mm] FORMAT.

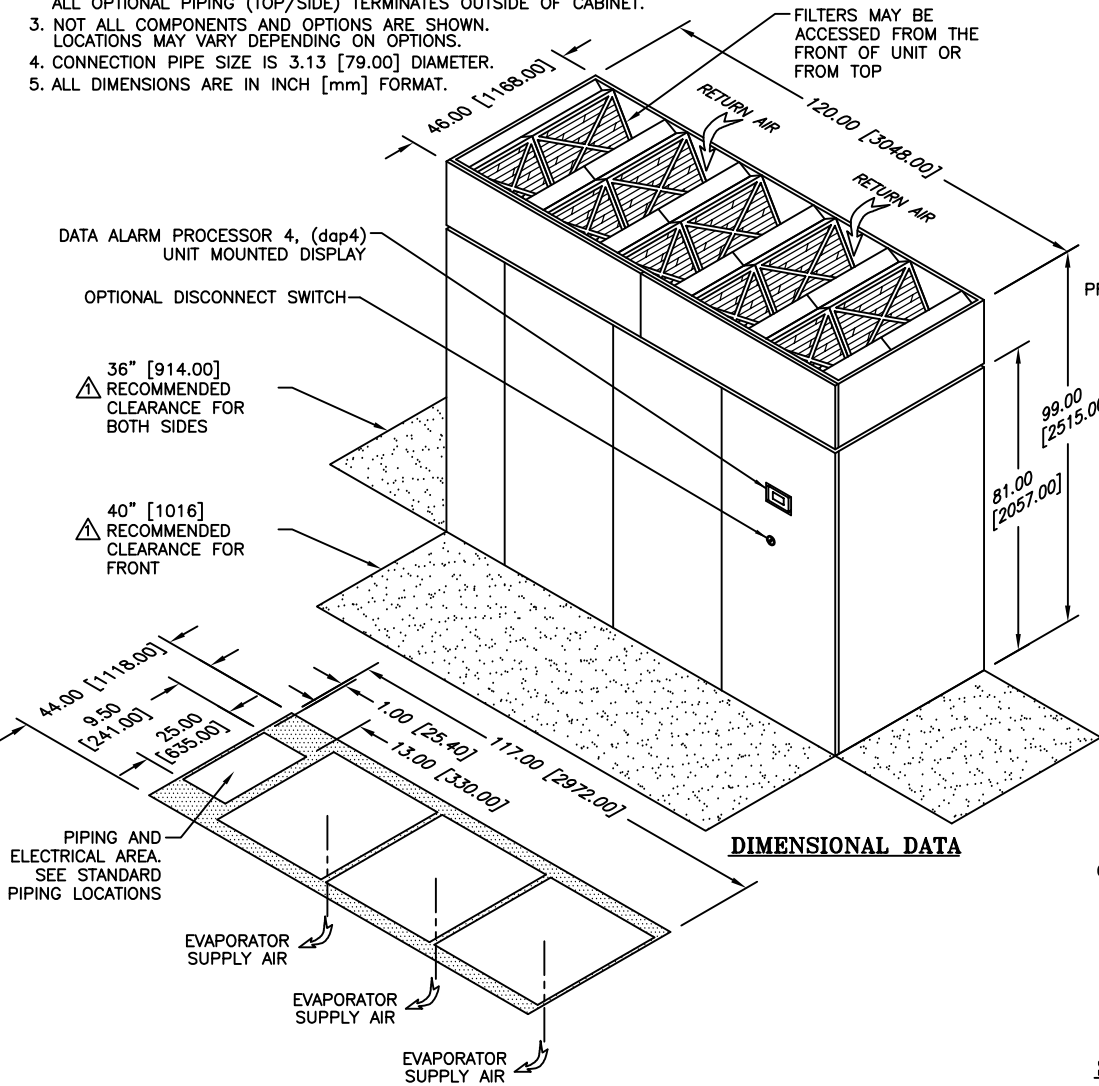


DIMENSIONAL DATA

FLOOR CUTOUT DIMENSIONS

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
E	UPDATED NOTES & TITLEBLOCK	03-20-15	RRK	DM

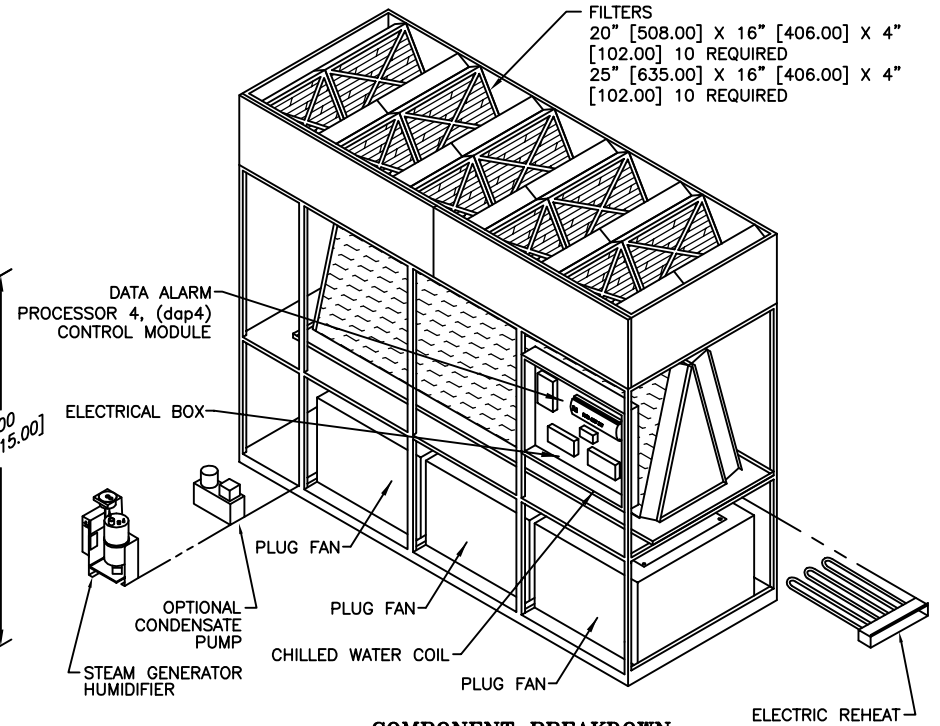

COMPONENT BREAKDOWN



STANDARD PIPING LOCATIONS

gForce GF
211 KW
CHILLED WATER DOWNFLOW

dataaire

DRAWN BY :	J. PATTON	SCALE:	NONE
CHECKED BY :		SH	1 OF 1
DATE :	08-05-2010	REV	E

PART OF
560-900-703
DWG NO.