


**NOTES:**


1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY, CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN.
4. ALL DIMENSIONS ARE IN INCH [mm] FORMAT.
5. SEE TABLE FOR CONNECTION PIPE SIZES.

UNIT (TON)	CONNECTION PIPE SIZE (Ø)			
	2	3	4	5
LIQUID/HOT GAS (AIR COOLED)	1/2 [12.70]	1/2 [12.70]	1/2 [12.70]	1/2 [12.70]
SUPPLY/RETURN (WATER/GLYCOL)	3/4 [19.05]	3/4 [19.05]	1 1/8 [29.00]	1 1/8 [29.00]


REVISIONS			
REV	DESCRIPTION	DATE	BY
L	RELOCATED CONDENSATE DRAIN	11-19-15	RRK

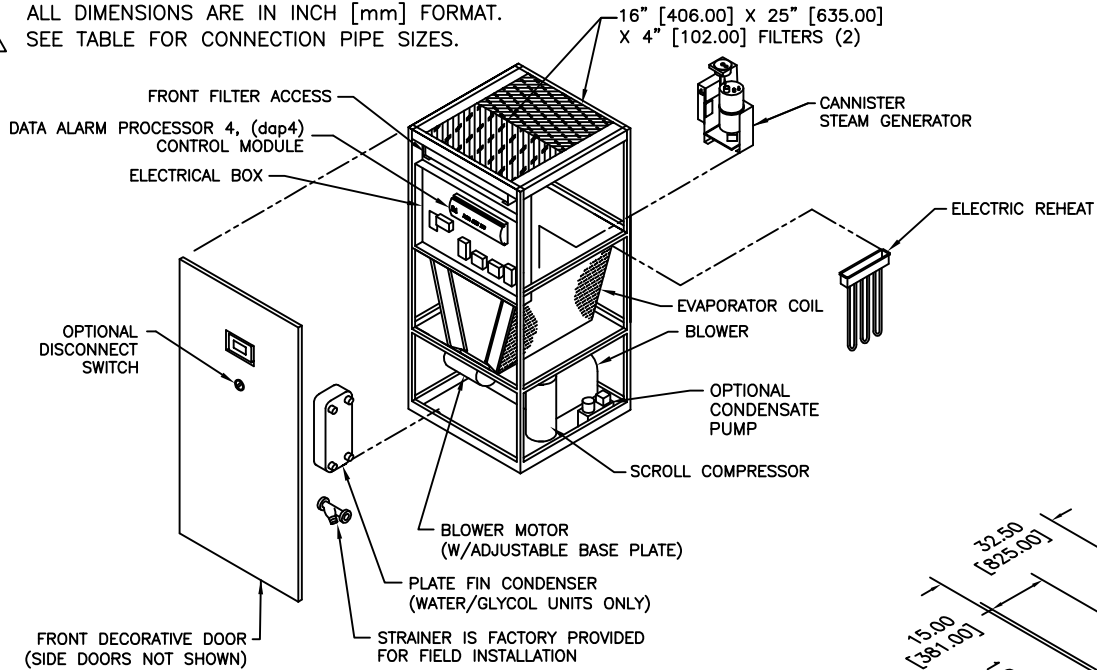

**COMPONENT BREAKDOWN**

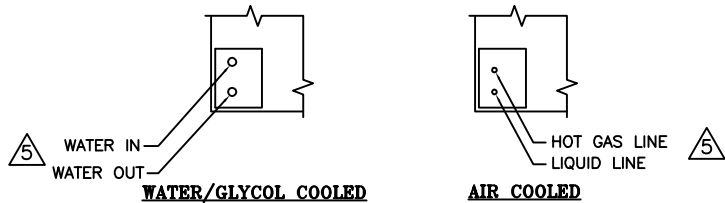


**STANDARD PIPING LOCATIONS**

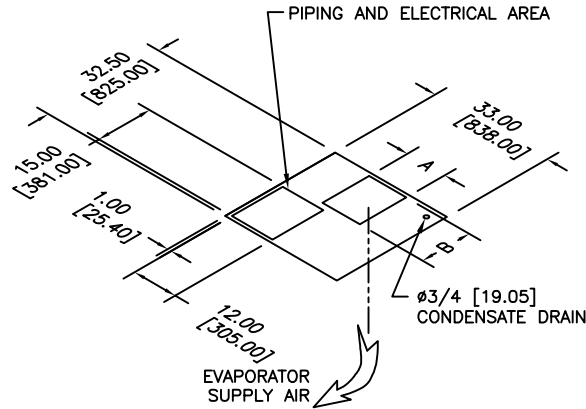

**FLOOR CUTOUT DIMENSIONS**

MODEL	"A"	"B"
2-3 TON	10.63 [270.00]	11.50 [292.00]
4-5 TON	10.88 [276.00]	13.63 [347.00]

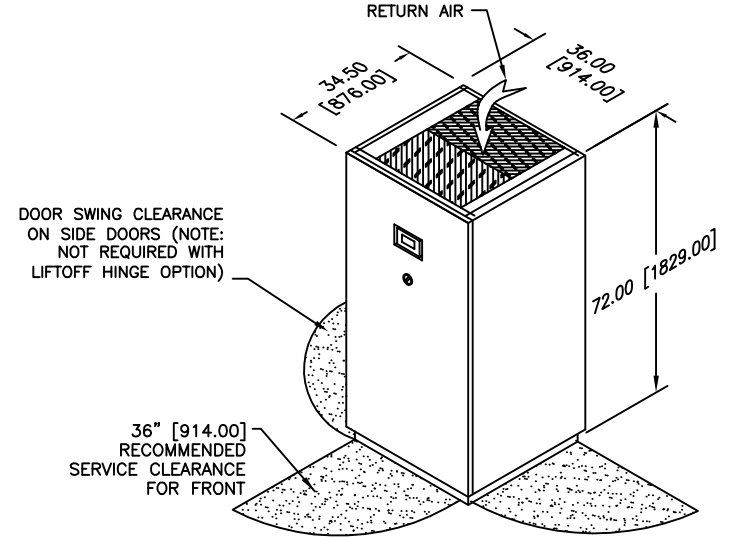

**DIMENSIONAL DATA**

2-5 TON  
DX DOWNFLOW DATA TEMP  
WITH V-TYPE COIL

**dataaire**

DRAWN BY : G. SALDIVAR	SCALE: NONE
CHECKED BY :	SH 1 OF 1
DATE : 11-02-06	REV L

PART OF

**524-900-042**  
DWG NO.