
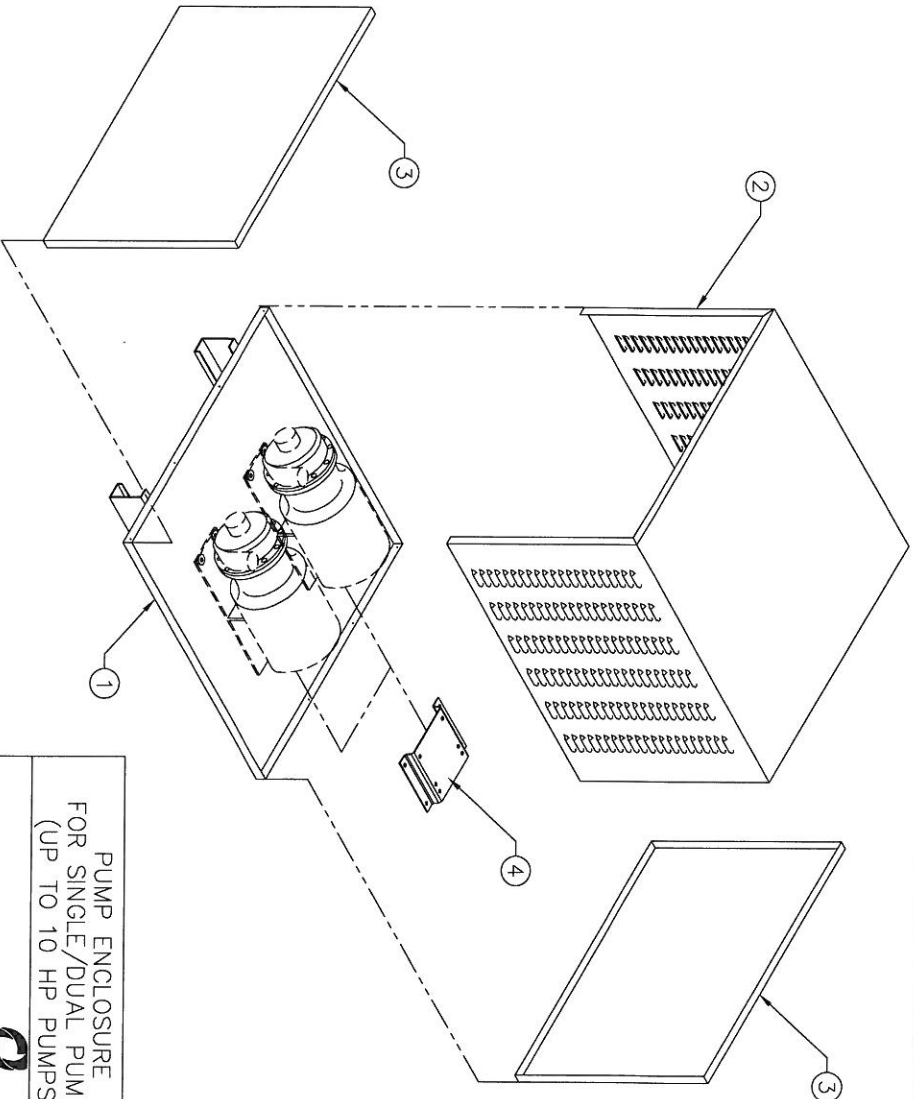


- NOTES:**
1. REFER TO UNIT INSTALLATION MANUAL FOR RECOMMENDED PIPING.
 2. ISOLATION PADS OR EQUIVALENT ARE RECOMMENDED FOR MOUNTING THE ENCLOSURE TO STRUCTURE.
 3. PUMPS ARE MOUNTED WITHIN ENCLOSURE WHEN ORDERED TOGETHER.
 4. IN COLD CLIMATE AREA, ENCLOSURE SHOULD BE MOUNTED ABOVE EXPECTED SNOW LEVEL.

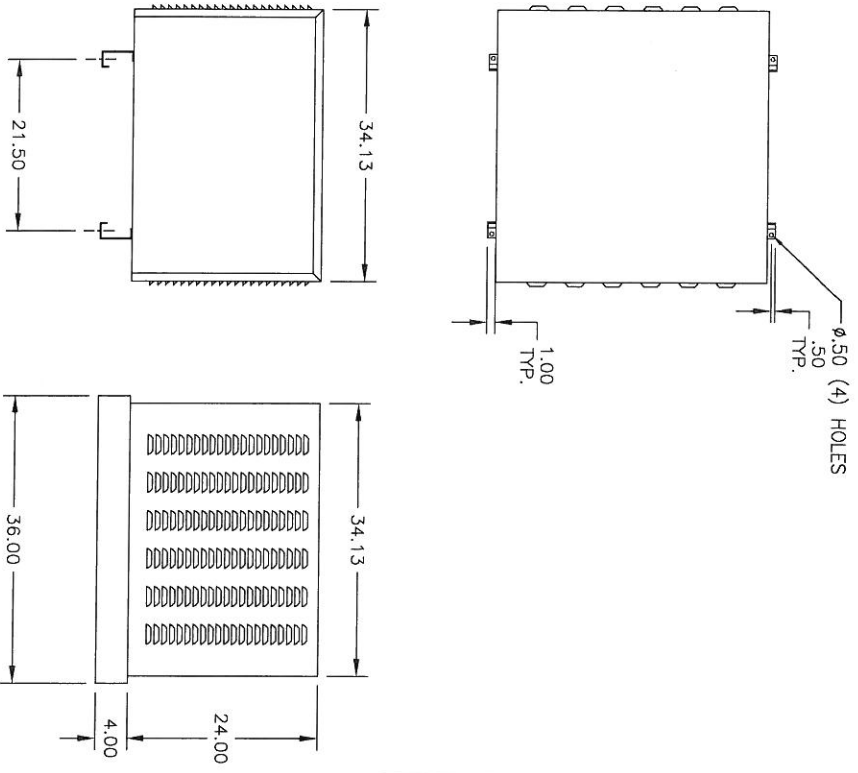

REV		DESCRIPTION		DATE	BY	FROM
M		ADJUSTED BASE ASSY LEGS & PLACEMENT		05-11-17	RK	RV

ASSEMBLY PARTS LIST			
ITEM #	PART NUMBER	QTY.	DESCRIPTION
1	532-722-200	1	PUMP BASE ASSEMBLY
2	532-022-211	1	COVER
3	532-022-212	2	END PANEL (MATRIX:532-022-112)
4	532-021-100	1 PER	PUMP MOUNT BRKT (3HP PUMPS ONLY)

PUMP ENCLOSURE
FOR SINGLE/DUAL PUMPS
(UP TO 10 HP PUMPS)

dataire

DRAWN BY : ACROSS SCALE: NONE

CHECKED BY : SH 1 OF 1

DATE : 08-11-1992 REV M

PART OF

532-822-200

DWG NO.