



NOTES:

1. FACTORY RECOMMENDED CLEARANCES ARE 36" [914.00] OF OPEN SPACE AT THE FRONT AND SIDES OF THE UNIT, WHICH ARE MINIMUM CLEARANCES REQUIRED. CONSULT LOCAL BUILDING CODES AND NEC REQUIREMENTS FOR ADDITIONAL CLEARANCE REQUIREMENTS.

2. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

⚠️ SUCTION LINES APPLY TO "AO" TYPE UNITS.
HOT GAS LINES APPLY TO "CO" TYPE UNITS.

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
J	CORRECTED PIPING CHART/LINE SIZING	05-22-19	RK	DM

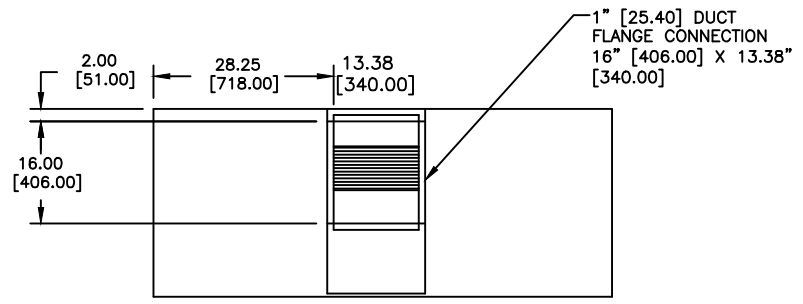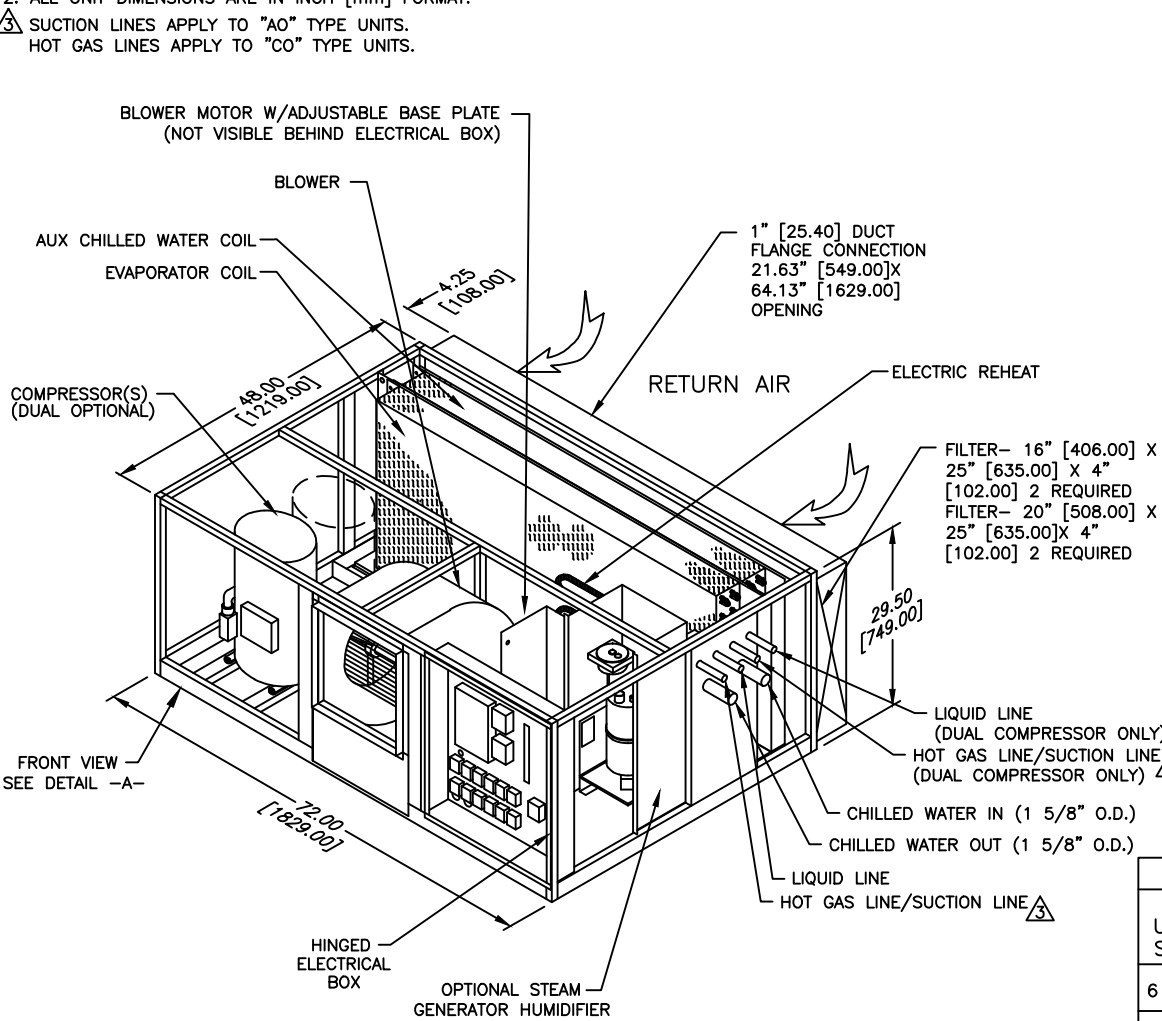

DETAIL -A-
FRONT VIEW

AIR COOLED INDOOR EVAPORATOR
(SHOWN WITHOUT PANELS)

DALA-XXXX AO & CO TYPE AIR COOLED INDOOR EVAPORATOR UNIT W/AUX. CW COIL 6-13 TON

dataaire

DRAWN BY : J. HERNANDEZ SCALE: NONE
 CHECKED BY : TM SH 1 OF 1
 DATE : 12-30-2005 REV J

PART OF

536-900-013
DWG NO.

PIPING CHART					
UNIT SIZE	MODEL TYPE	LIQUID LINE	HOT GAS LINE (CO TYPE)	SUCTION LINE (AO TYPE)	
6 TON	SINGLE	5/8"O.D.	5/8"O.D.	1 1/8"O.D.	
	DUAL	1/2"O.D.	1/2"O.D.	7/8"O.D.	
8 TON	SINGLE	5/8"O.D.	3/4"O.D.	1 3/8"O.D.	
	DUAL	1/2"O.D.	5/8"O.D.	7/8"O.D.	
10 TON	SINGLE	5/8"O.D.	3/4"O.D.	1 3/8"O.D.	
	DUAL	1/2"O.D.	5/8"O.D.	1 1/8"O.D.	
13 TON	SINGLE	7/8"O.D.	7/8"O.D.	1 3/8"O.D.	
	DUAL	5/8"O.D.	5/8"O.D.	1 1/8"O.D.	