





REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
D	DECREASED CONDENSING UNIT HEIGHT 4"	05-15-17	MTC	MP

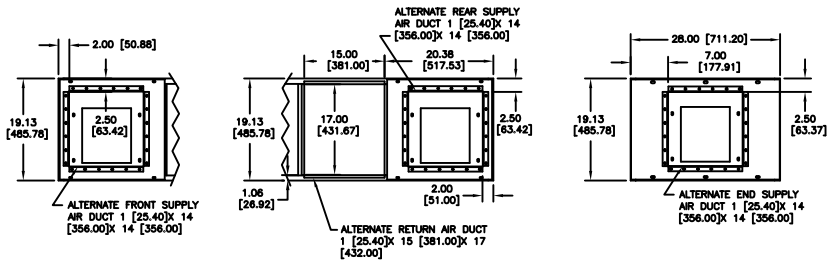

DETAIL -A-
ALTERNATE SUPPLY AIR &
RETURN AIR LOCATIONS

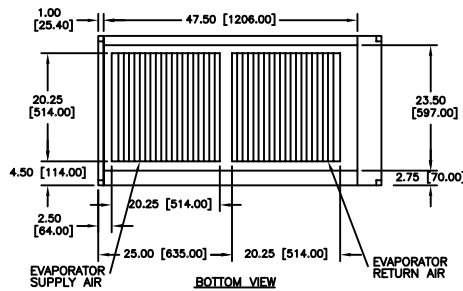

DETAIL -B-
EVAPORATOR SUPPLY & RETURN AIR

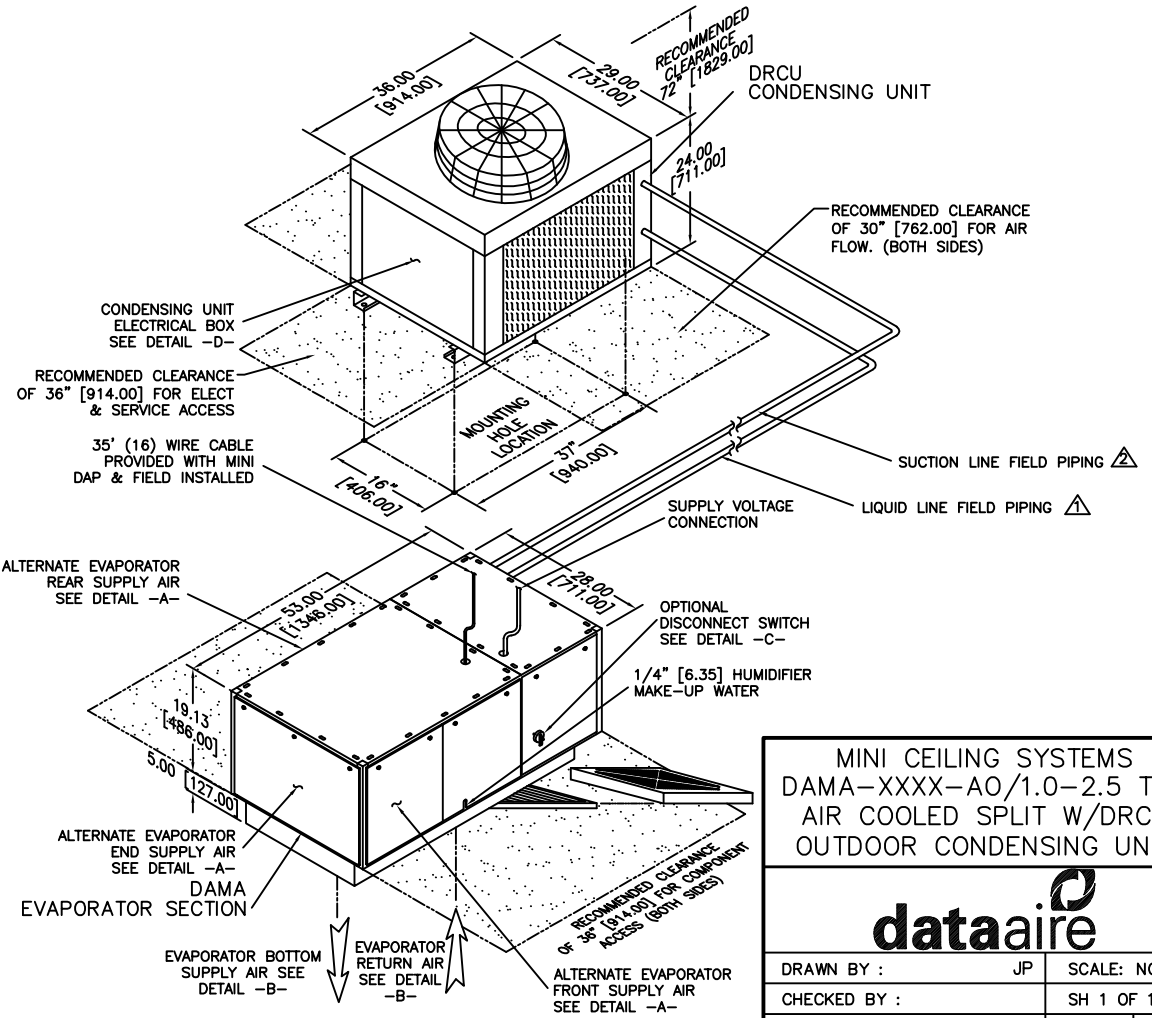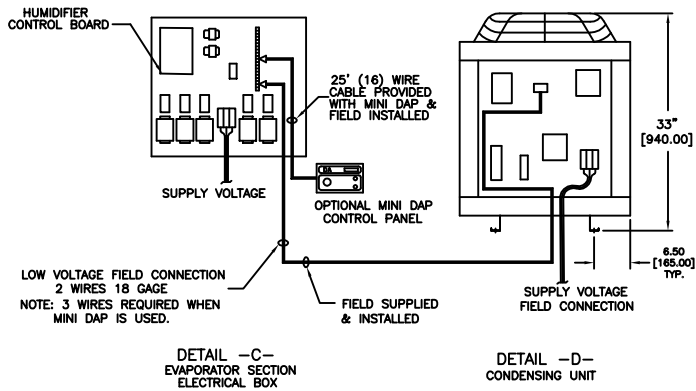

NOTES:

- ▲ LIQUID LINE CONNECTION SIZE IS 1/2" [12.70] FOR BOTH SECTIONS.
 - ▲ SUCTION LINE CONNECTION SIZE IS 3/4" [19.05] FOR BOTH SECTIONS.
- (THESE CONNECTION SIZES ARE NOT NECESSARILY THE RECOMMENDED FIELD PIPING SIZES.)

MINI CEILING SYSTEMS
DAMA-XXXX-AO/1.0-2.5 TON
AIR COOLED SPLIT W/DRCU
OUTDOOR CONDENSING UNIT

dataaire

DRAWN BY :	JP	SCALE:	NONE
CHECKED BY :		SH 1 OF 1	
DATE :	12-28-1998	REV	D

PART OF

538-900-072
DWG NO.