




REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
B	REMOVED AND CONSOLIDATED DETAIL VIEWS	03-10-16	RRK	SI

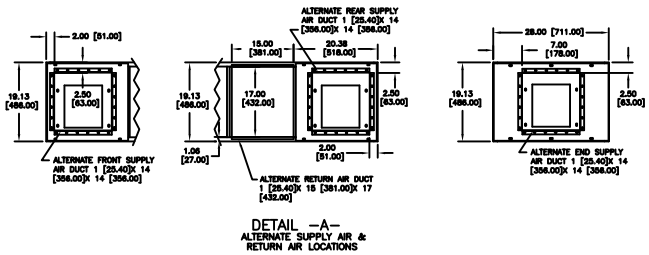

DETAIL -A-
ALTERNATE SUPPLY AIR &
RETURN AIR LOCATIONS

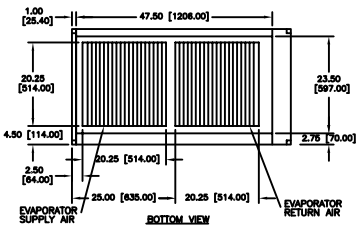


DETAIL -B-
EVAPORATOR SUPPLY & RETURN AIR

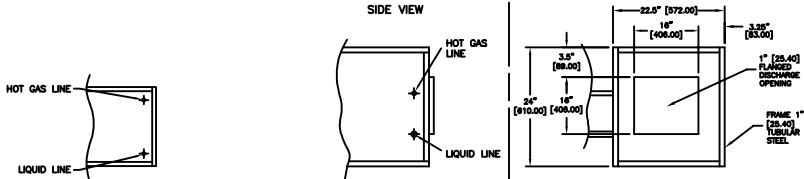


DETAIL -D-
CONDENSER DISCHARGE AIR

DETAIL -C-
PIPING LOCATION

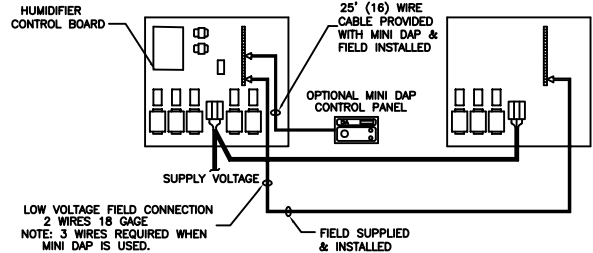

DETAIL -E-
EVAPORATOR SECTION
ELECTRICAL BOX

DETAIL -E-
CONDENSING UNIT
ELECTRICAL BOX

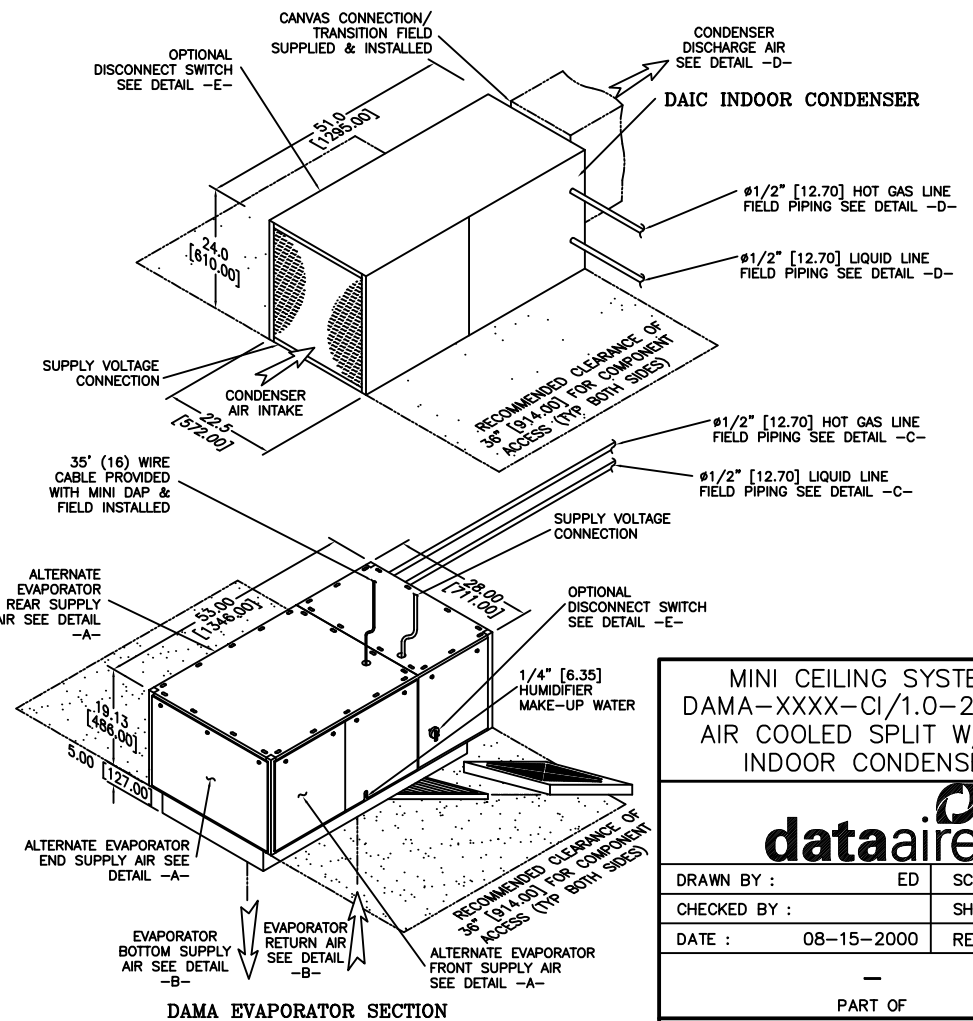

DAMA EVAPORATOR SECTION

MINI CEILING SYSTEMS
DAMA-XXXX-CI/1.0-2.5 TON
AIR COOLED SPLIT W/DAIC
INDOOR CONDENSER

dataaire

DRAWN BY :	ED	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	08-15-2000	REV B

PART OF

538-900-082
DWG NO.