


NOTES:


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE/REAR) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. FILTERS ARE RECOMMENDED IF OUTSIDE AIR IS DUCTED TO THE CONDENSER INTAKE.
- 5. ALL DIMENSIONS ARE IN INCH[mm] FORMAT.

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
B	ADDED NOTE 4 AND METRIC DIMENSIONS	01-03-19	TB	-

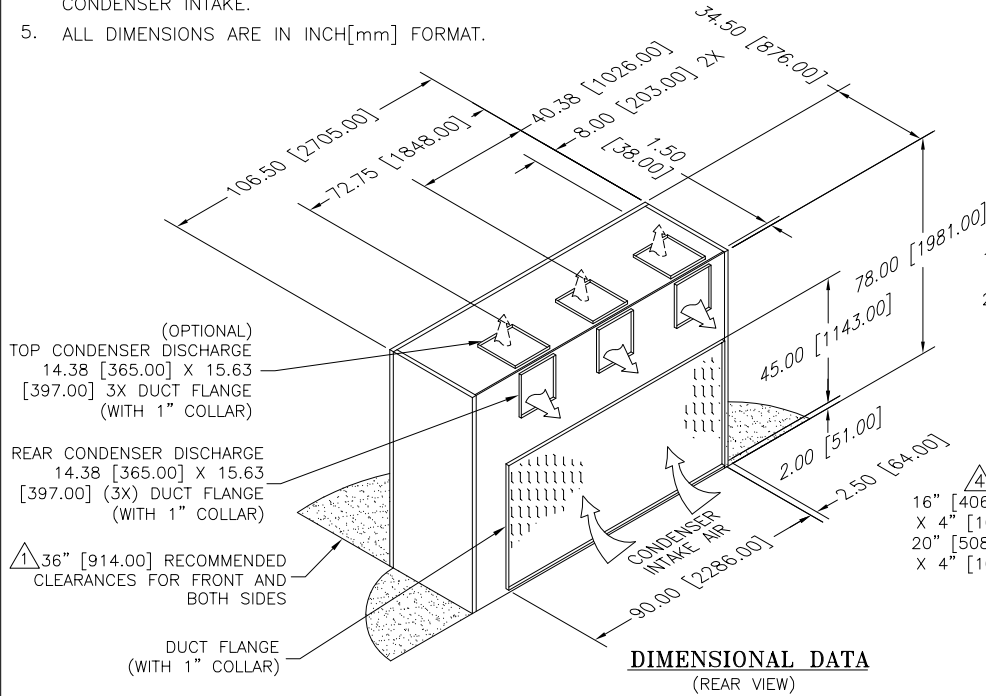


DIMENSIONAL DATA
(REAR VIEW)

MODEL NUMBER	PIPING INLET (DIA STUB)	PIPING OUTLET (DIA STUB)	PHYSICAL DATA			ELECTRICAL DATA			
			QTY FANS	TOTAL CFM	UNIT WEIGHT	QTY MOTORS	HP	FLA 208/230V	FLA 460V
DARC 21	1 1/8	7/8	3	15000	1400	3	3	27.0	13.2
DARC 24	1 1/8	7/8	3	14750	1500	3	3	27.0	13.2
DARC 28	1 1/8	7/8	3	14500	1600	3	3	27.0	13.2
DAFC 21	2 1/8	2 1/8	3	15000	1440	3	3	27.0	13.2
DAFC 24	2 1/8	2 1/8	3	14750	1540	3	3	27.0	13.2
DAFC 28	2 1/8	2 1/8	3	14500	1640	3	3	27.0	13.2

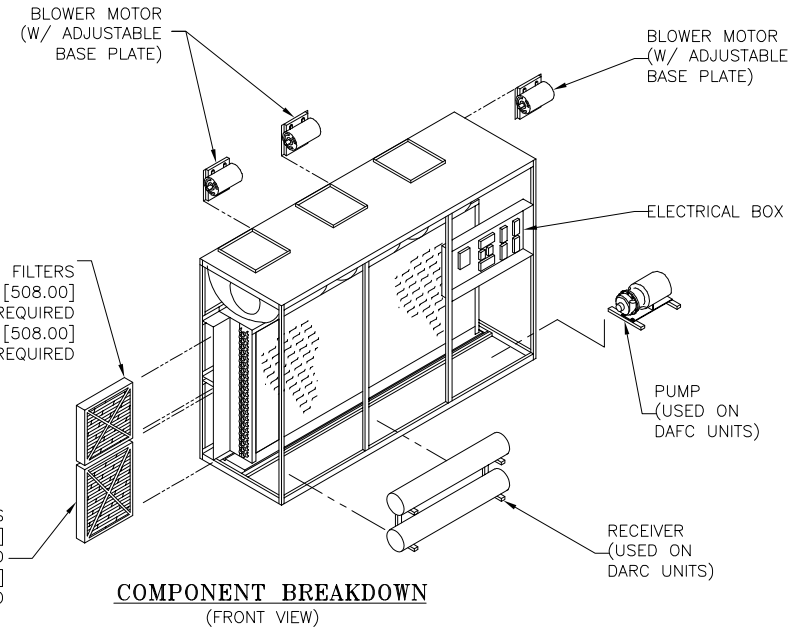

COMPONENT BREAKDOWN
(FRONT VIEW)

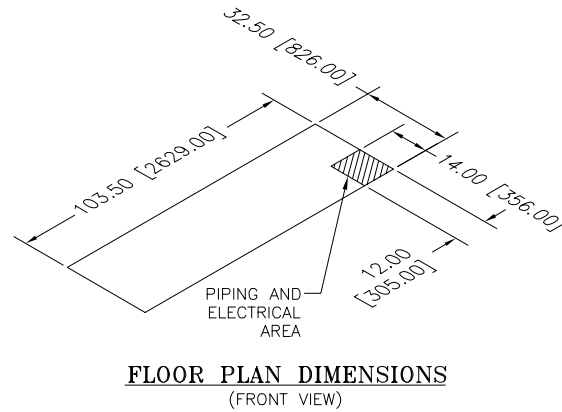

FLOOR PLAN DIMENSIONS
(FRONT VIEW)

DATA AIR PIGGY BACK
HEAT EXCHANGER
21-28 TON DARC & DAFC UNITS

dataaire

DRAWN BY : J. PATTON		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE : 02-28-2011	REV	B	

PART OF
543-900-001
DWG NO.