



NOTES:


1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL PIPING TERMINATES INSIDE OF CABINET.
3. ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.
4. FILTERS ARE RECOMMENDED IF OUTSIDE AIR IS DUCTED TO THE CONDENSER INTAKE.
5. ALL DIMENSIONS ARE IN INCHES[mm] FORMAT.

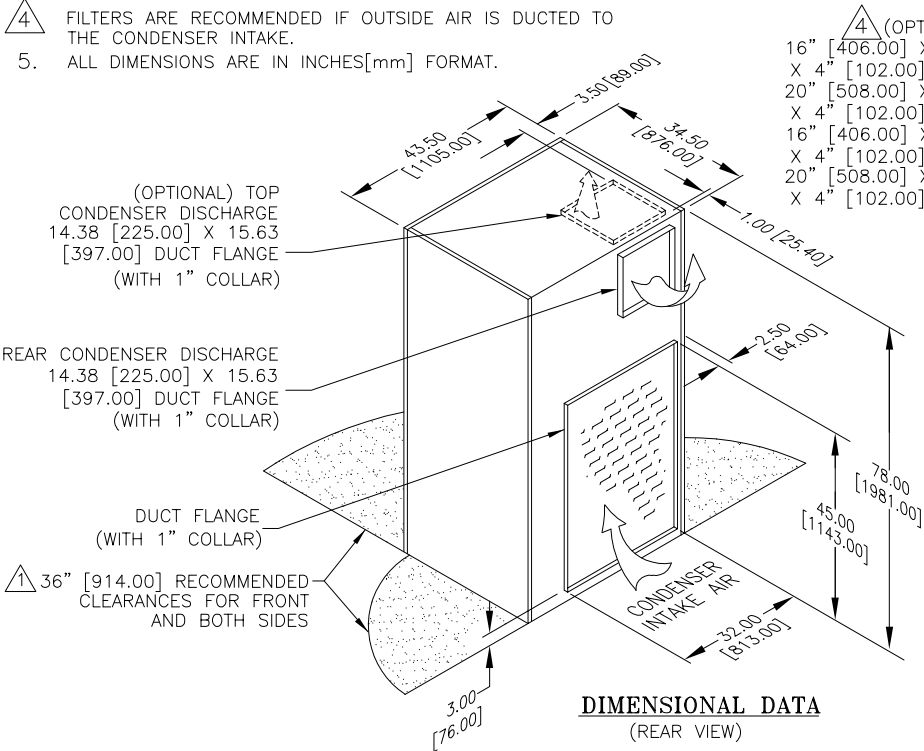

REVISIONS			
REV	DESCRIPTION	DATE	BY
-	-	-	-

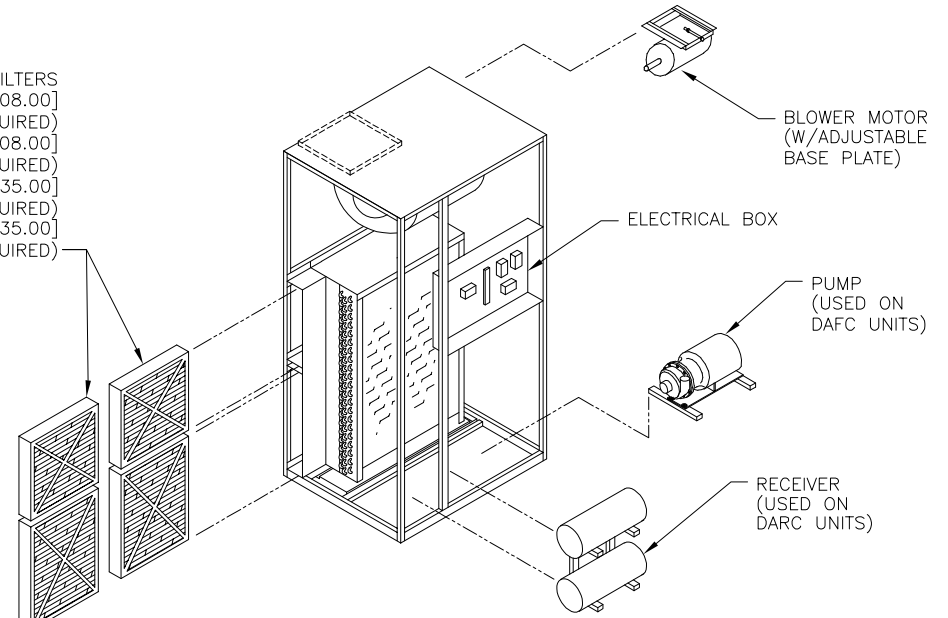

COMPONENT BREAKDOWN
(FRONT VIEW)

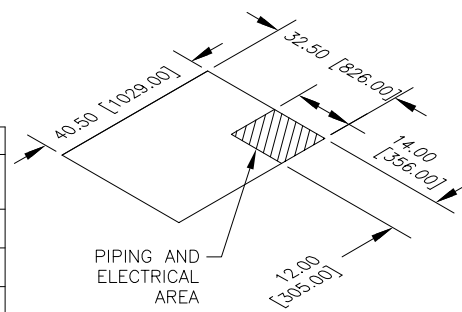

FLOOR PLAN DIMENSIONS
(FRONT VIEW)

MODEL NUMBER	PIPING INLET DIA STUB	PIPING OUTLET DIA STUB	PHYSICAL DATA			ELECTRICAL DATA			
			QTY FANS	TOTAL CFM	UNIT WEIGHT	QTY MOTORS	HP	FLA 208/230V	FLA 460V
DARC 7	1 1/8	7/8	1	4900	820	1	3.0	9.0	4.4
DARC 9	1 1/8	7/8	1	4800	840	1	3.0	9.0	4.4
DAFC 6	1 5/8	1 5/8	1	5000	800	1	3.0	9.0	4.4
DAFC 7	1 5/8	1 5/8	1	4900	820	1	3.0	9.0	4.4
DAFC 9	1 5/8	1 5/8	1	4800	840	1	3.0	9.0	4.4

DATA AIRE PIGGY BACK
HEAT EXCHANGER
6, 7, & 9 TON DARC & DAFC UNITS

DRAWN BY : T. BLAIR SCALE: NONE
CHECKED BY : A. DELGADO SH 1 OF 1
DATE : 1-2-2019 REV -

PART OF
543-900-005
DWG NO.