
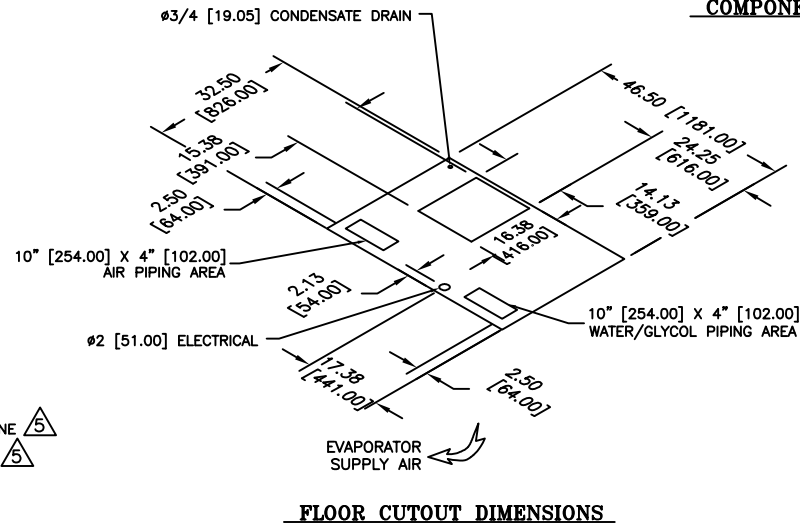
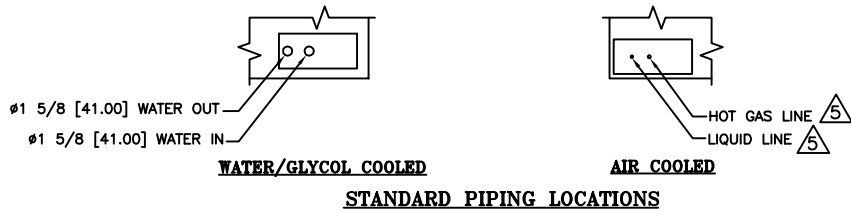
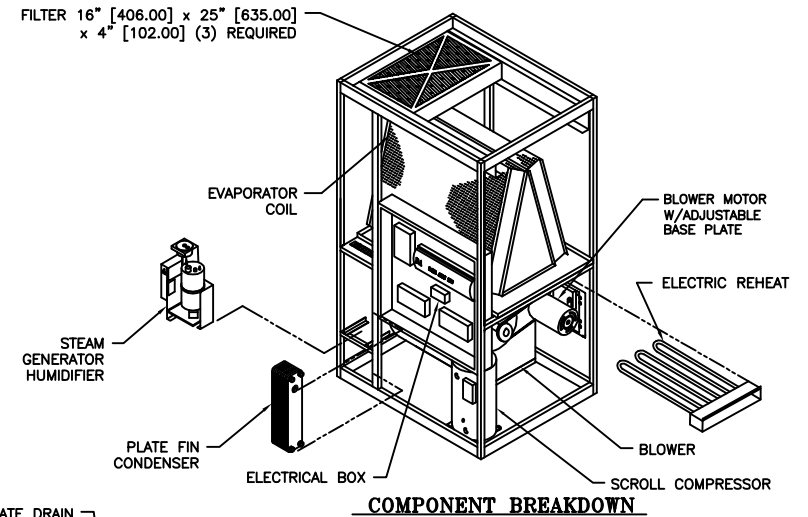


**NOTES:**

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY, CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN.
4. ALL DIMENSIONS ARE IN INCH [mm] FORMAT.
5. SEE TABLE FOR CONNECTION PIPE SIZES.

UNIT (TON)	CONNECTION PIPE SIZE (φ)					
	8		10		13	
LIQUID	5/8	[15.88]	5/8	[15.88]	7/8	[22.23]
HOT GAS	3/4	[19.05]	3/4	[19.05]	7/8	[22.23]

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
J	UPDATED PIPE SIZES AND ADDED TABLE	10-29-15	RRK	-

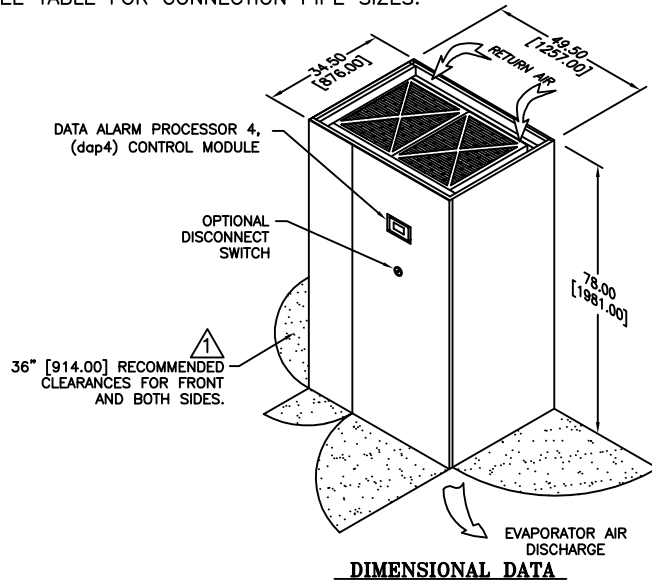

8, 10, & 13 TON  
DOWNFLOW MODULAR  
DATA TEMP

**dataaire**

DRAWN BY :	E. DIAZ	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	06-04-98	REV J

PART OF

**550-900-024**  
DWG NO.