
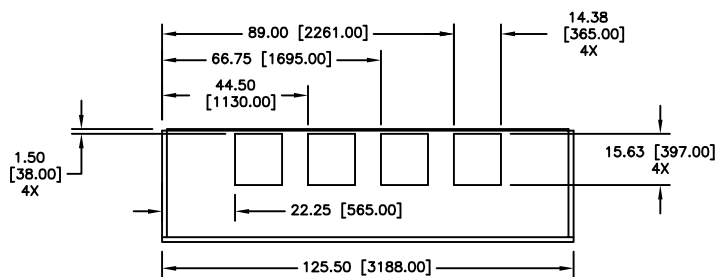
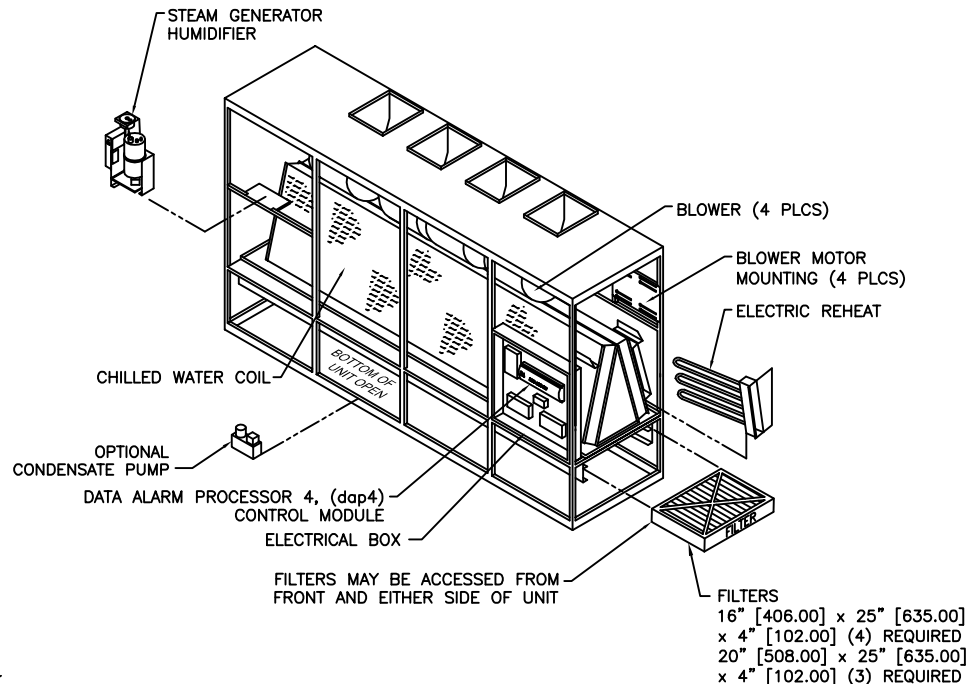



NOTES:

- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.
- 4. CONNECTION PIPE SIZE IS 2 5/8 [67.00] DIAMETER FOR 40, 45 & 50 TON.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.
- 6. CONDENSATE DRAIN LINE NOT PROVIDED WITH PUMP.

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
Q	UPDATED FILTER QUANTITIES, ADDED OPTIONAL CONDENSATE PUMP, ADDED NOTE 6.	02-13-17	MTC	RV

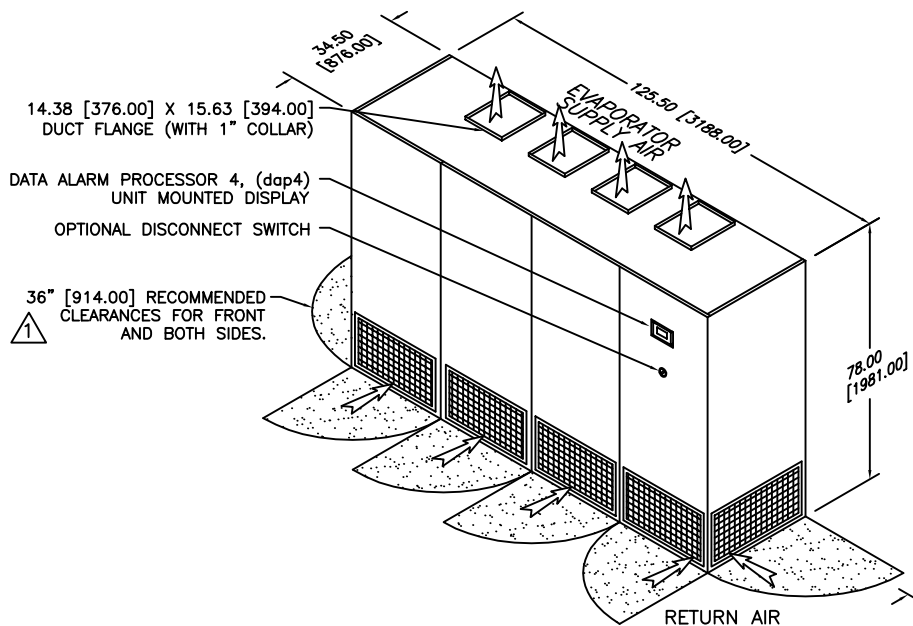

DIMENSIONAL DATA

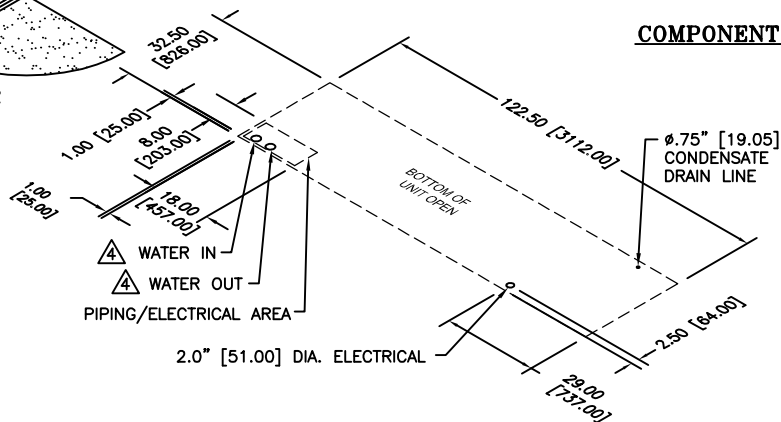

FOOTPRINT LAYOUT
(PIPING & ELECTRICAL AREA REFERENCE)

COMPONENT BREAKDOWN

DATA AIRE
40, 45 & 50 TON
UPFLOW CHILLED WATER



DRAWN BY :	J. PIZZO	SCALE:	NONE
CHECKED BY :		SH	1 OF 1
DATE :	03-24-1998	REV	Q

PART OF

550-900-065
DWG NO.