


NOTES:


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. THESE UNITS REQUIRE OUTDOOR CONDENSING UNITS.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.
- 6. SEE TABLE FOR CONNECTION PIPE SIZES.

UNIT (KW)	CONNECTION PIPE SIZE (ø)		
	28	35	46
LIQUID	5/8 [15.88]	5/8 [15.88]	7/8 [22.23]
SUCTION	1 3/8 [35.00]	1 3/8 [35.00]	1 3/8 [35.00]

DIM 'A'	
78.00"	[1981.00] WITH 3KW FAN
84.00"	[2134.00] WITH 5KW FAN

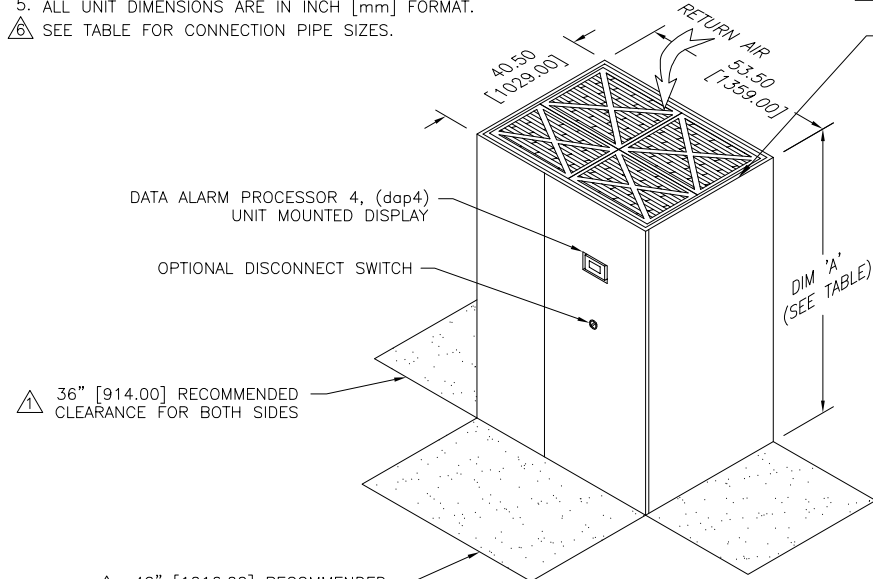


DIMENSIONAL DATA

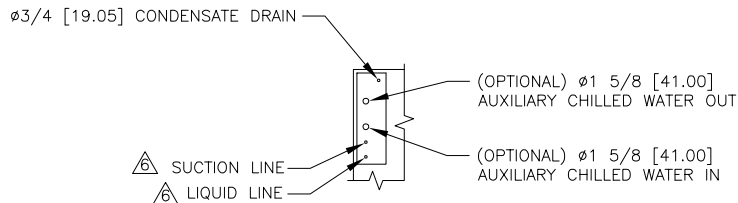


AIR COOLED

STANDARD PIPING LOCATIONS

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
G	REMOVED WATER/GLYCOL PIPING LOCATIONS	04-30-19	MTC	AS

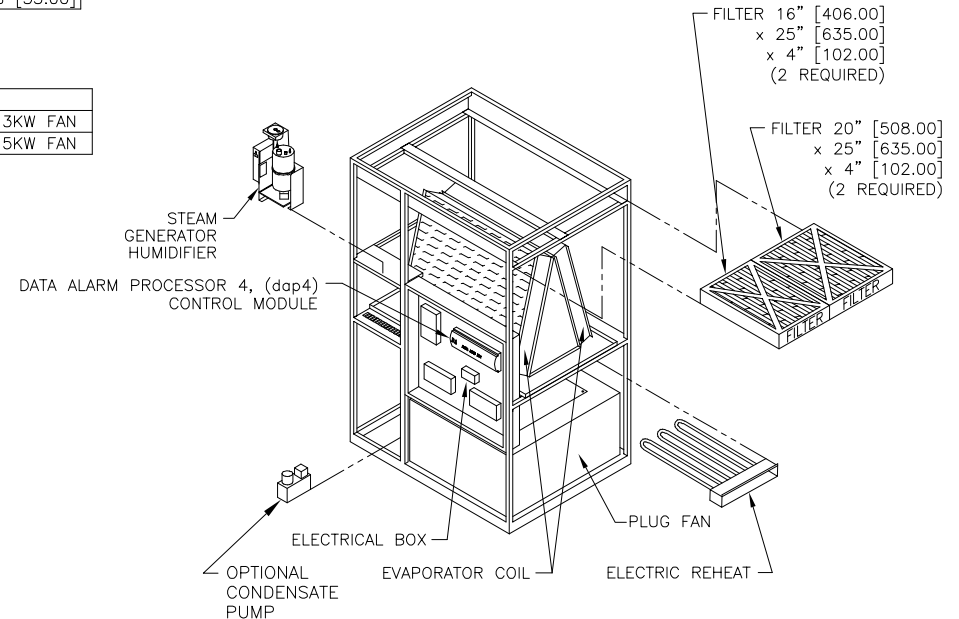

COMPONENT BREAKDOWN

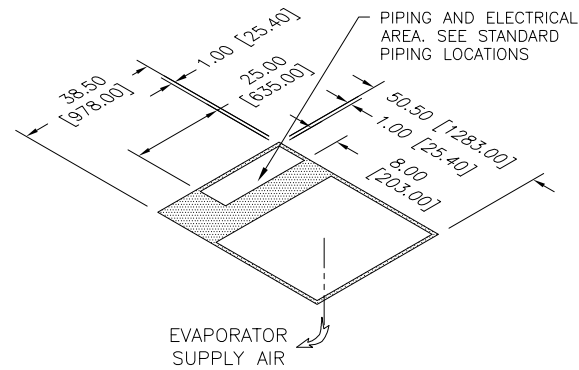

FLOOR CUTOUT DIMENSIONS

gForce GT
28, 35 & 46 KW
DX DOWNFLOW
WITH CONDENSING UNIT



DRAWN BY :	GABE	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	06-14-10	REV G

PART OF

560-900-201
DWG NO.