


NOTES:

- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. OPENINGS ARE NOT PROVIDED FOR ALTERNATE ACCESS LOCATIONS.
- 5. THESE UNITS REQUIRE REMOTE CONDENSERS.
- 6. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.
- 7. SEE TABLE FOR CONNECTION PIPE SIZES.


UNIT (KW)	CONNECTION PIPE SIZE (Ø)		
	28	35	46
LIQUID	5/8 [15.88]	5/8 [15.88]	7/8 [22.23]
HOT GAS	3/4 [19.05]	3/4 [19.05]	7/8 [22.23]

DIM 'A'	
78.00" [1981.00]	WITH 3KW FAN
84.00" [2134.00]	WITH 5KW FAN


REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
-	-	-	-	-

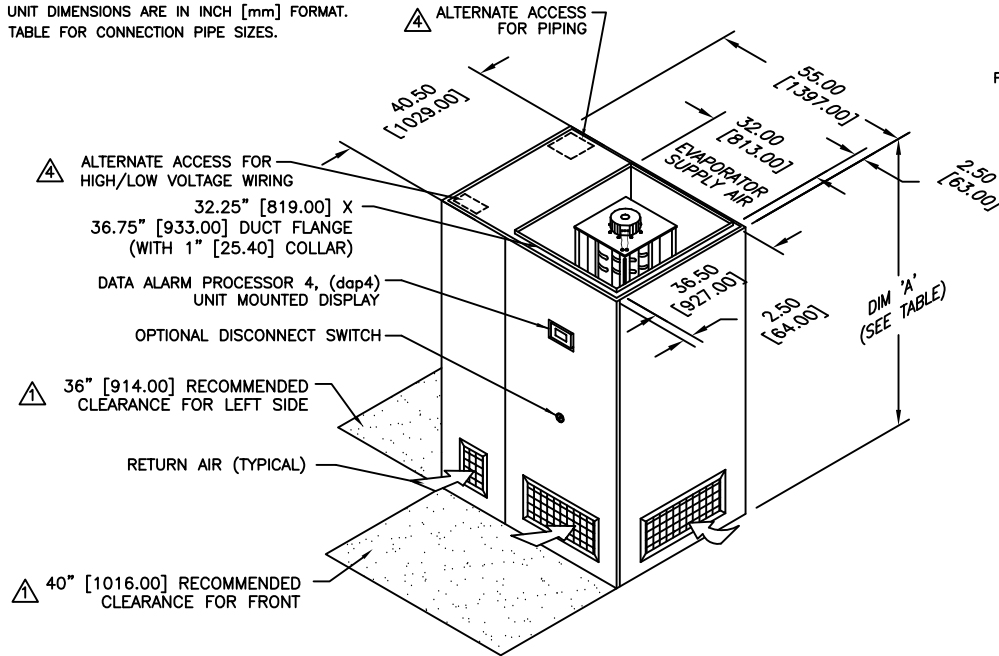


DIMENSIONAL DATA

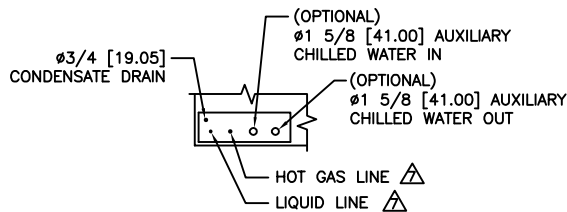

STANDARD PIPING LOCATIONS

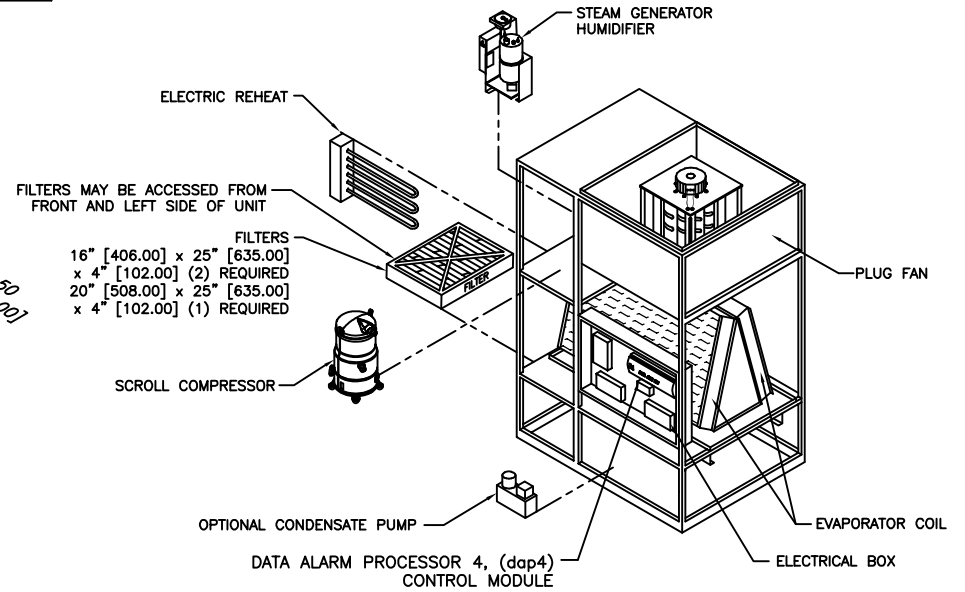

COMPONENT BREAKDOWN

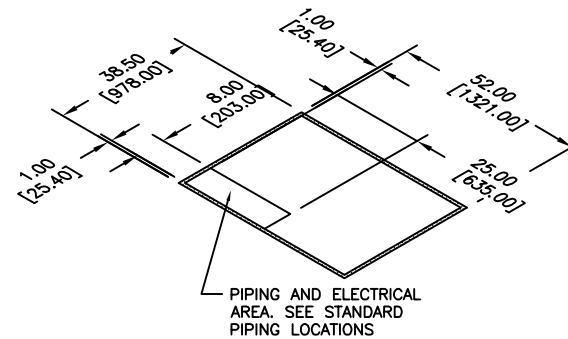

FRAME DIMENSIONS

gForce GT
28, 35 & 46 KW
AIR COOLED UPFLOW
WITH REMOTE CONDENSER



DRAWN BY :	RKALIN	SCALE: NONE
CHECKED BY :	JROCHA	SH 1 OF 1
DATE :	12-01-2020	REV -

PART OF

560-900-204
DWG NO.