


NOTES:


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. SEE TABLE FOR CONNECTION PIPE SIZES.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

	CONNECTION PIPE SIZE (ø)							
UNIT (KW)	21		28		35		46	
LIQUID	1/2	[12.70]	1/2	[12.70]	1/2	[12.70]	5/8	[15.88]
HOT GAS	1/2	[12.70]	5/8	[15.88]	5/8	[15.88]	5/8	[15.88]

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
K	REMOVED NOTE FOR TOP PIPING OPENINGS	01-18-21	AP	BM

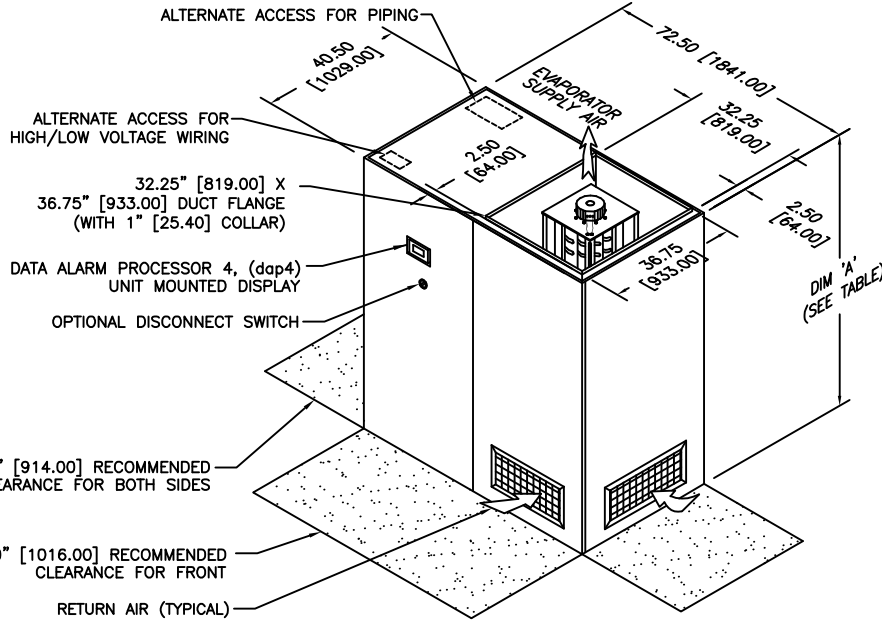


DIMENSIONAL DATA

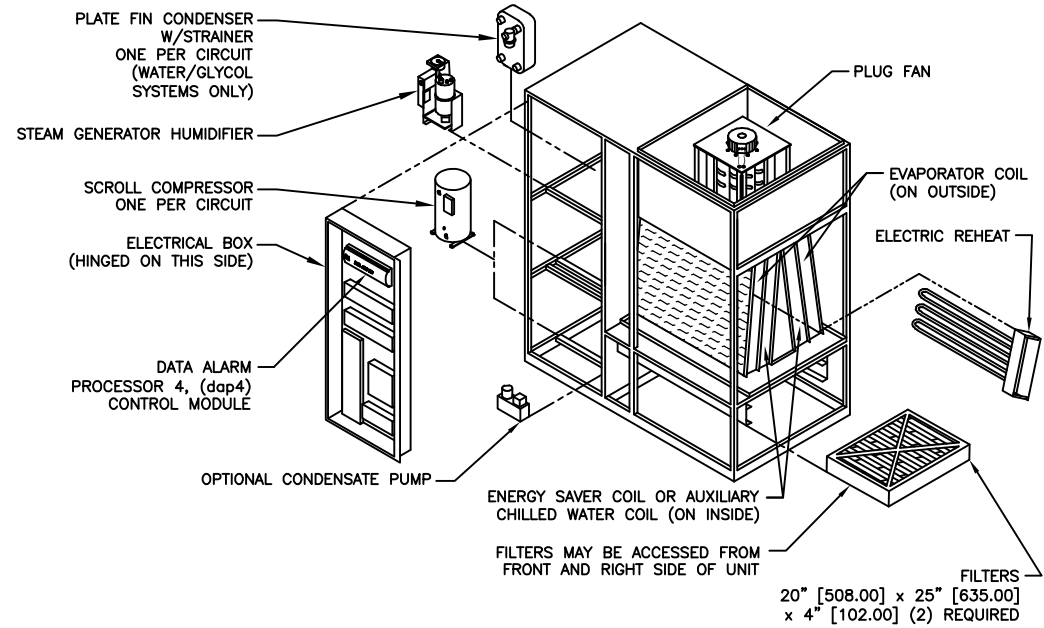


COMPONENT BREAKDOWN

DIM 'A'	
78.00"	[1981.00] WITH 3KW FAN
84.00"	[2134.00] WITH 5KW FAN

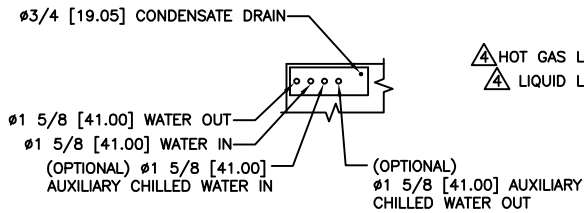


WATER/GLYCOL COOLED

STANDARD PIPING LOCATIONS

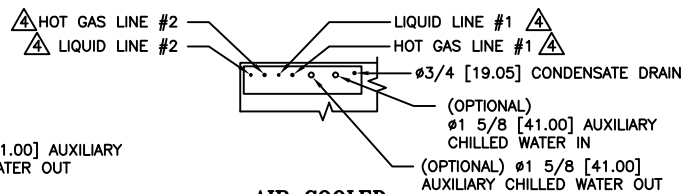

AIR COOLED

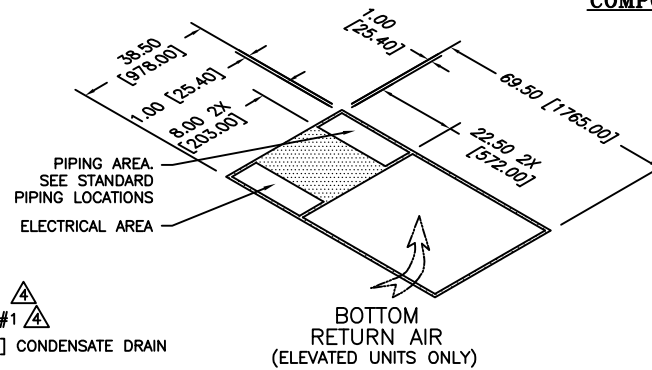

FLOOR CUTOUT DIMENSIONS

gForce GF
21, 28, 35 & 46 KW
DX UPFLOW W/ENERGY SAVER OR
AUXILIARY CHILLED WATER COIL



DRAWN BY :	GABE	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	06-16-10	REV K

PART OF

560-900-304
DWG NO.