


**NOTES:**


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL PIPING TERMINATES INSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. THESE UNITS REQUIRE OUTDOOR CONDENSING UNITS.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

| DIM 'A' |                        |
|---------|------------------------|
| 78.00"  | [1981.00] WITH 3KW FAN |
| 84.00"  | [2134.00] WITH 5KW FAN |


| REVISIONS |                                      |          |    |      |
|-----------|--------------------------------------|----------|----|------|
| REV       | DESCRIPTION                          | DATE     | BY | FROM |
| B         | REMOVED NOTE FOR TOP PIPING OPENINGS | 01-19-21 | AP | BM   |

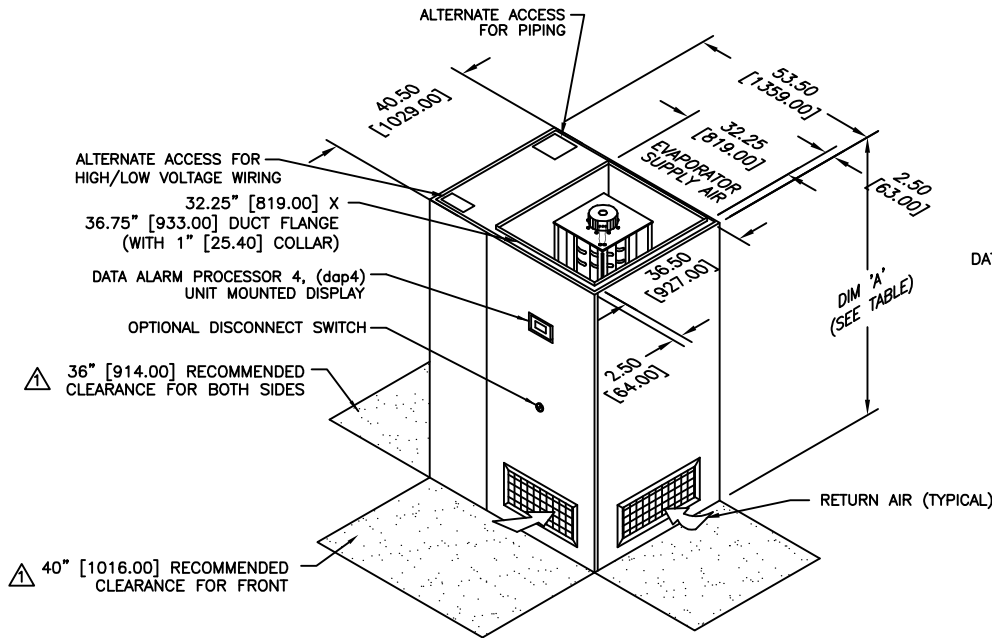

**DIMENSIONAL DATA**

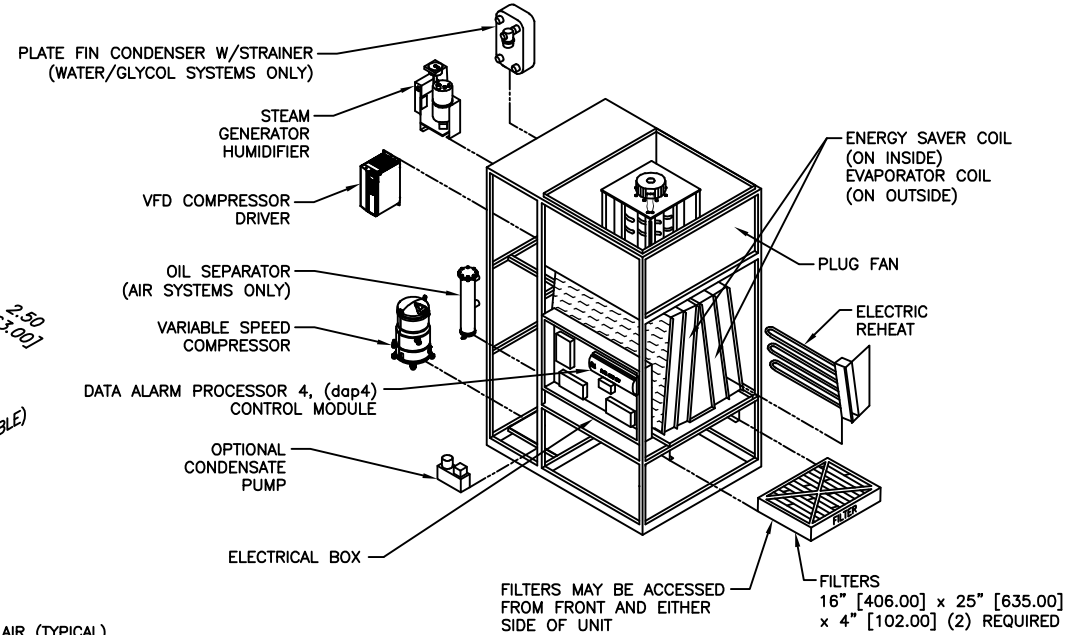


**COMPONENT BREAKDOWN**

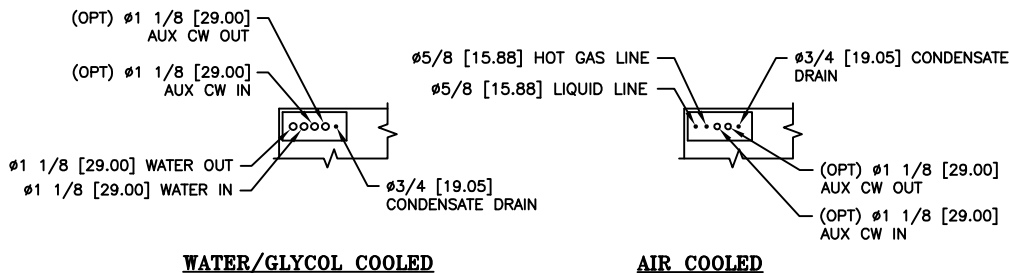

**WATER/GLYCOL COOLED**

**AIR COOLED**

**STANDARD PIPING LOCATIONS**

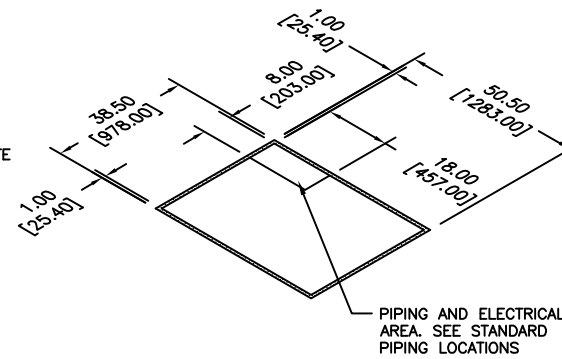

**FRAME DIMENSIONS**

gForce ULTRA GU  
22 KW DX UPFLOW  
WITH ENERGY SAVER COILS

**dataaire**

|                        |            |             |   |
|------------------------|------------|-------------|---|
| DRAWN BY : J. PERKINS  |            | SCALE: NONE |   |
| CHECKED BY : S. INYANG |            | SH 1 OF 1   |   |
| DATE :                 | 03-23-2015 | REV         | B |
| PART OF                |            |             |   |
| <b>563-900-722</b>     |            |             |   |
| DWG NO.                |            |             |   |