NOTES:

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
4. SEE TABLE FOR CONNECTION PIPE SIZES.
5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

CONNECTION PIPE SIZE (ø)		
UNIT (KW)	36	45
WATER IN/OUT	1 5/8 [41.00]	1 5/8 [41.00]
AUX CHW IN/OUT	1 5/8 [41.00]	1 5/8 [41.00]

DIM 'A'
78.00" [1981.00] WITH 3KW FAN
84.00" [2134.00] WITH 5KW FAN

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
D	REMOVED NOTE FOR TOP PIPING OPENINGS	01-19-21	AP	BM

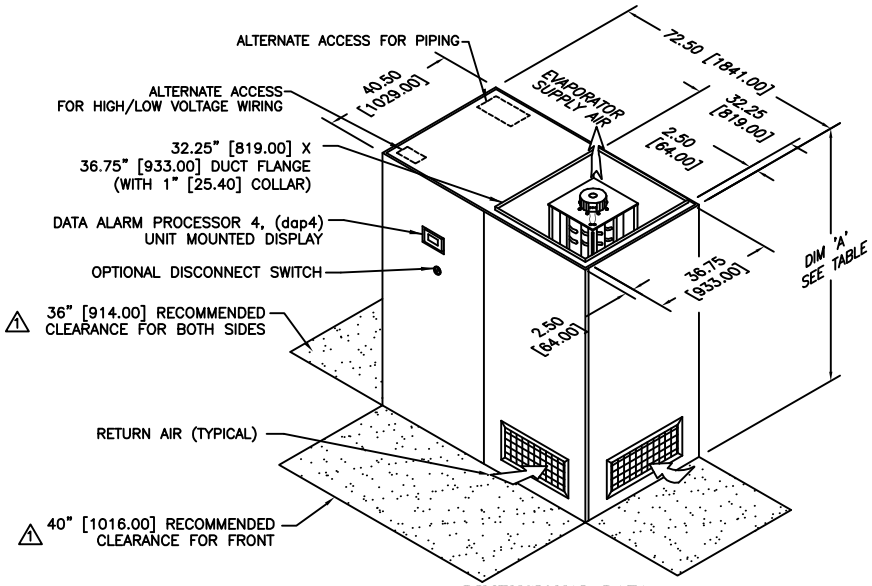

DIMENSIONAL DATA

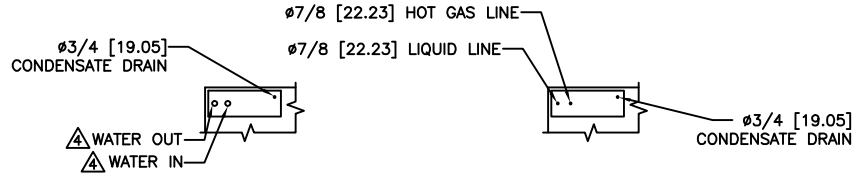

WATER/GLYCOL COOLED AIR COOLED

STANDARD PIPING LOCATIONS

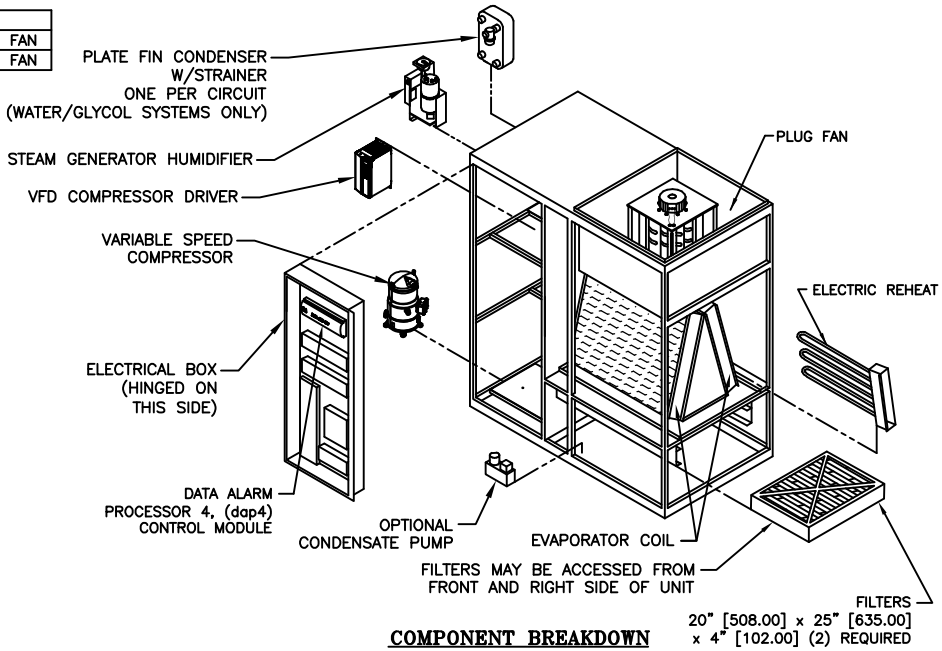

COMPONENT BREAKDOWN

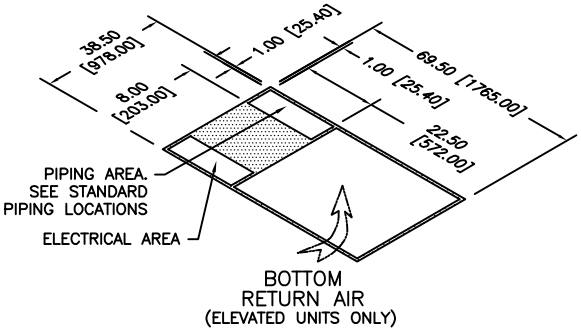

FLOOR CUTOUT DIMENSIONS

gForce ULTRA GU
36 & 45 KW
DX UPFLOW

dataaire

DRAWN BY :	RRK	SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE :	09-09-2014	REV	D

PART OF

563-900-741
DWG NO.

© Copyright 2014 Data Aire, Inc.