


NOTES:

- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. SEE TABLE FOR CONNECTION PIPE SIZES.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.


CONNECTION PIPE SIZE (Ø)			
UNIT (KW)	36		45
WATER IN/OUT	1 5/8	[41.00]	1 5/8 [41.00]
AUX CHW IN/OUT	1 5/8	[41.00]	1 5/8 [41.00]

DIM 'A'		
78.00"	[1981.00]	WITH 3KW FAN
84.00"	[2134.00]	WITH 5KW FAN

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
E	REMOVED NOTE FOR TOP PIPING OPENINGS	01-19-21	AP	BM

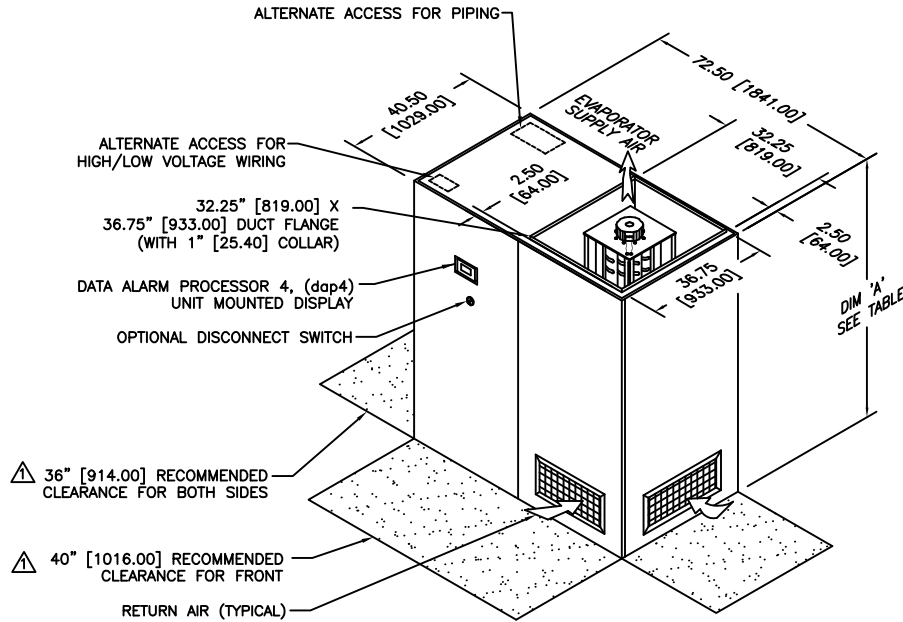


DIMENSIONAL DATA

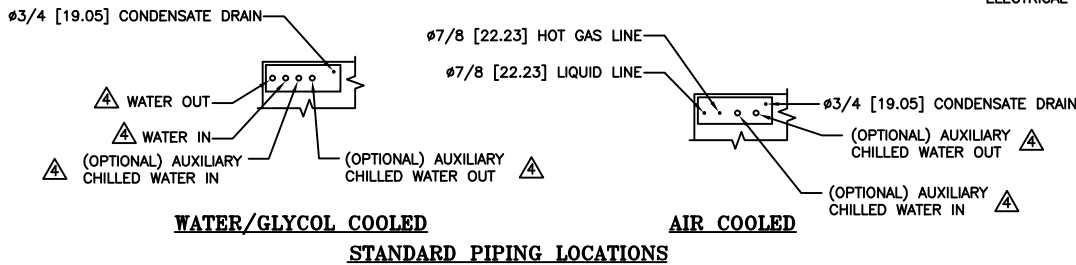


WATER/GLYCOL COOLED STANDARD PIPING LOCATIONS

AIR COOLED

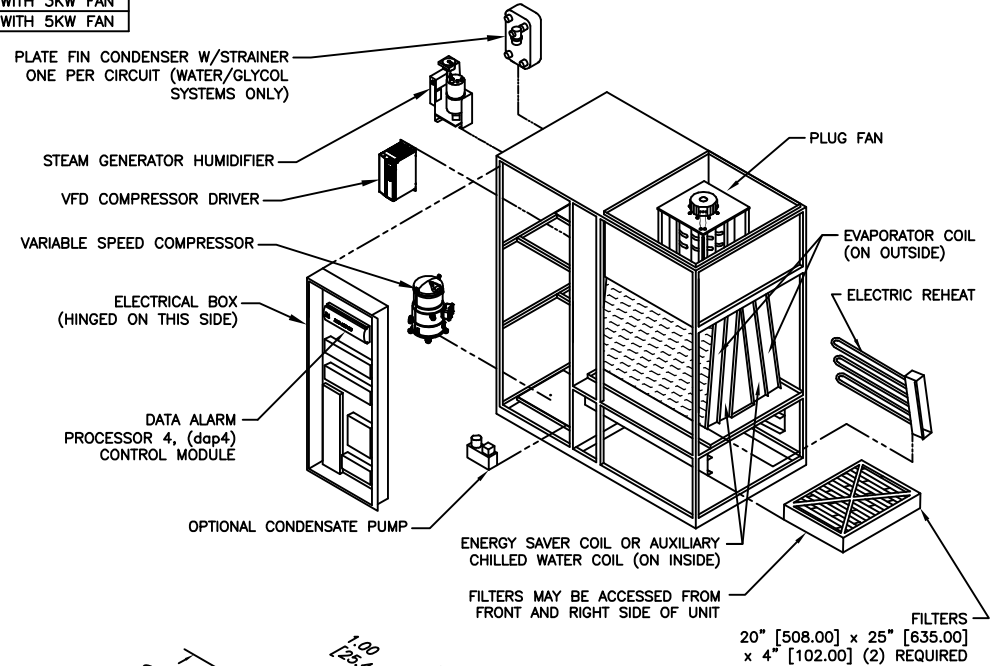

COMPONENT BREAKDOWN

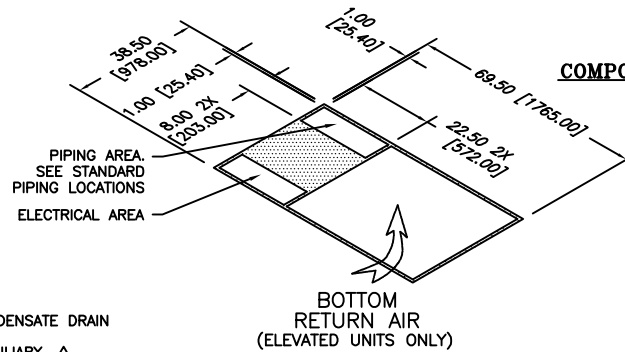

FLOOR CUTOUT DIMENSIONS

gForce ULTRA GU
36 & 45 KW
DX UPFLOW W/ENERGY SAVER OR
AUXILIARY CHILLED WATER COIL

dataaire

DRAWN BY :	RRK	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	09-09-2014	REV E

PART OF
563-900-742
DWG NO.