


NOTES:


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. SEE TABLE FOR CONNECTION PIPE SIZES.
- 5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

CONNECTION PIPE SIZE (Ø)		
UNIT (KW)	70	91
WATER IN/OUT	1 5/8 [41.00]	2 1/8 [54.00]
AUX CHW IN/OUT	1 5/8 [41.00]	2 1/8 [54.00]

DIM 'A'	
78.00" [1981.00]	WITH 3KW FAN
84.00" [2134.00]	WITH 5KW FAN

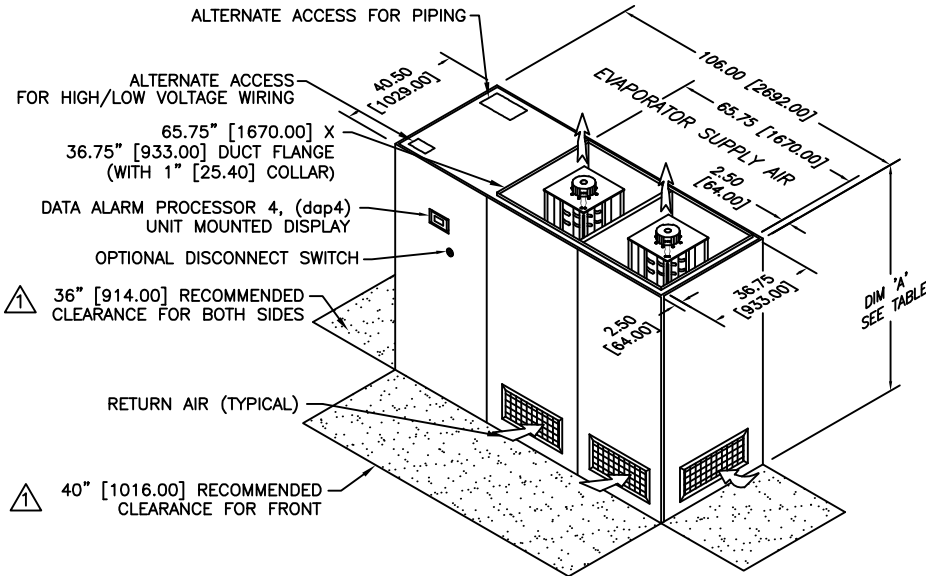

DIMENSIONAL DATA

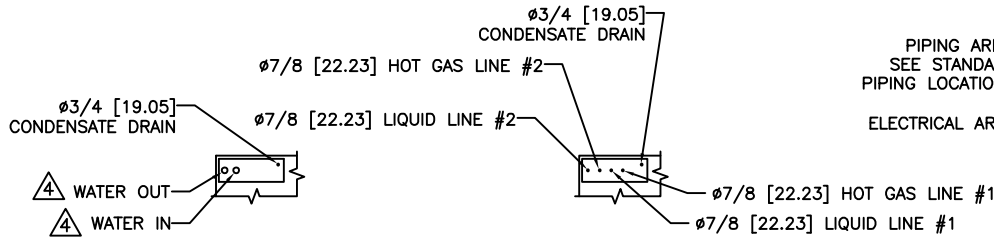


WATER/GLYCOL COOLED


AIR COOLED

STANDARD PIPING LOCATIONS

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
E	REMOVED NOTE FOR TOP PIPING OPENINGS	01-19-21	AP	BM

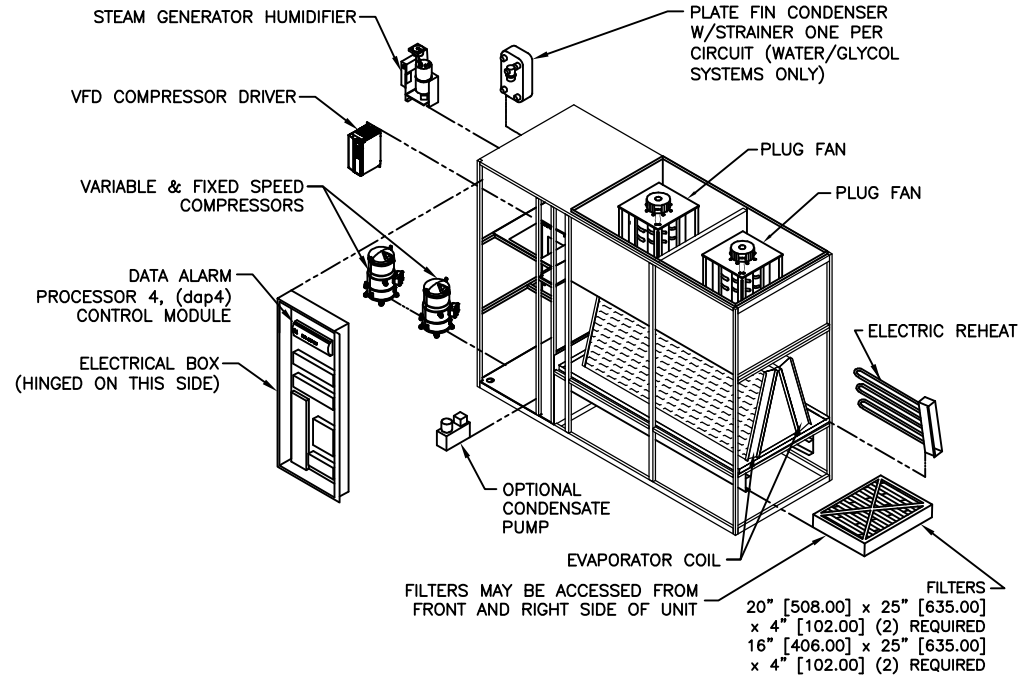

COMPONENT BREAKDOWN

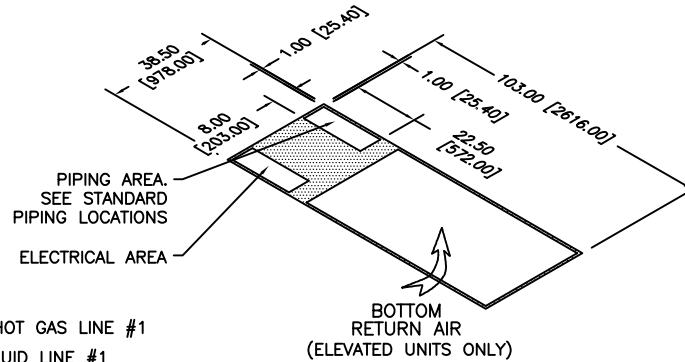

FLOOR CUTOUT DIMENSIONS

gForce ULTRA GU
70 & 91 KW
DX UPFLOW



DRAWN BY :	RRK	SCALE: NONE
CHECKED BY :		SH 1 OF 1
DATE :	09-10-2014	REV E

PART OF

563-900-761

DWG NO.