


**NOTES:**

1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
4. SEE TABLE FOR CONNECTION PIPE SIZES.
5. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.


CONNECTION PIPE SIZE (ø)			
UNIT (KW)	70		91
WATER IN/OUT	1 5/8 [41.00]	2 1/8 [54.00]	
AUX CHW IN/OUT	1 5/8 [41.00]	2 1/8 [54.00]	

DIM 'A'	
78.00" [1981.00]	WITH 3KW FAN
84.00" [2134.00]	WITH 5KW FAN

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
F	REMOVED NOTE FOR TOP PIPING OPENINGS	01-19-21	AP	BM

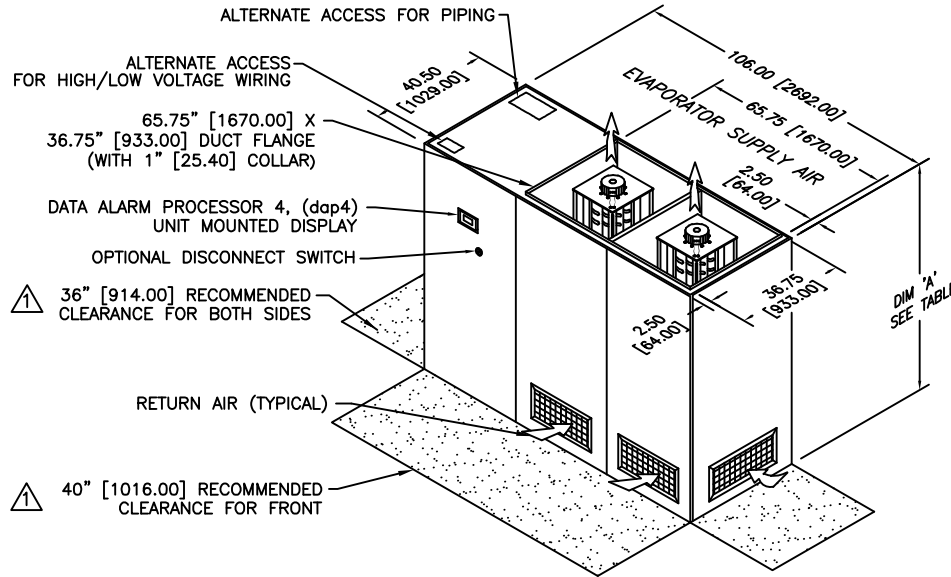


**DIMENSIONAL DATA**

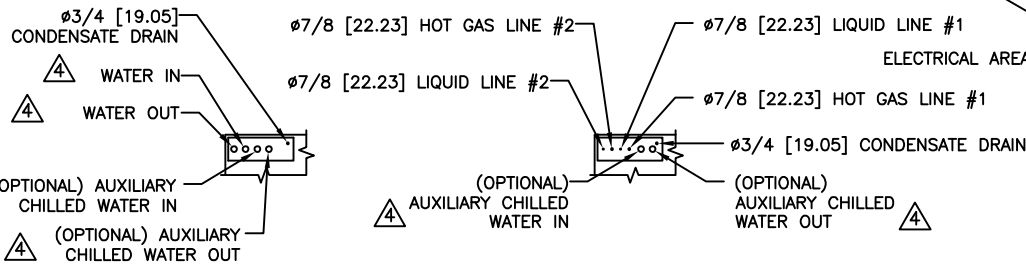


**WATER/GLYCOL COOLED STANDARD PIPING LOCATIONS**

**AIR COOLED**

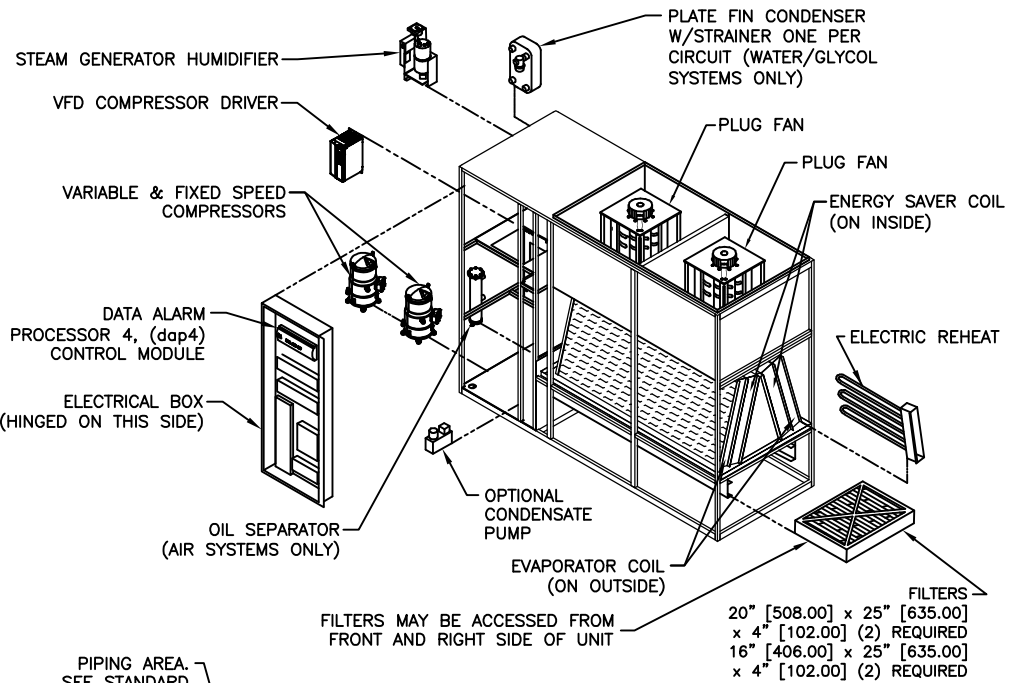

**COMPONENT BREAKDOWN**

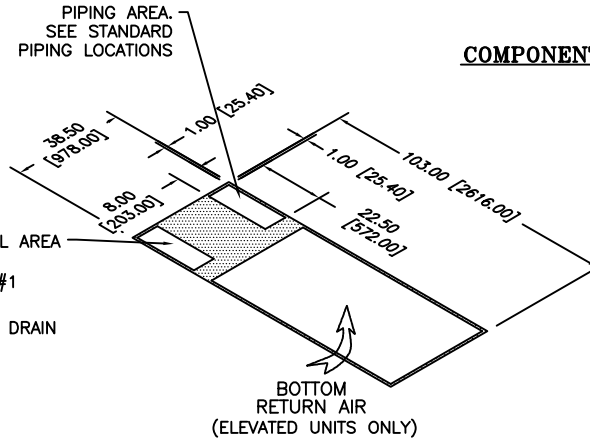

**FLOOR CUTOUT DIMENSIONS**

gForce ULTRA GU 70 & 91 KW/DX UPFLOW WITH ENERGY SAVER COIL			
<b>dataaire</b>			
DRAWN BY :	RRK	SCALE:	NONE
CHECKED BY :		SH	1 OF 1
DATE :	09-10-2014	REV	F
PART OF			
563-900-762			
DWG NO.			