


NOTES:


- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

CONNECTION PIPE SIZE (Ø)	
LIQUID	1/2 [12.70]
HOT GAS	1/2 [12.70]
WATER IN	1-1/8 [29.00]
WATER OUT	1-1/8 [29.00]

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
C	UPDATED CONNECTION PIPE SIZE TABLE, ADDED COPYRIGHT	10-08-18	MC	AD

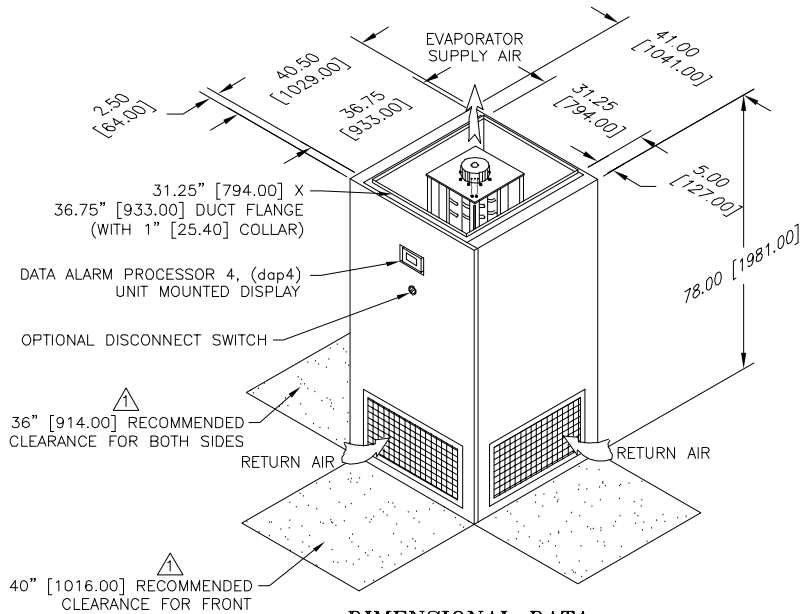

DIMENSIONAL DATA

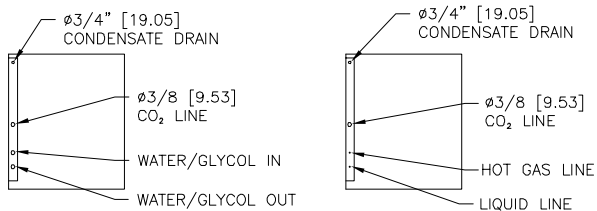


WATER/GLYCOL COOLED


AIR COOLED

STANDARD PIPING LOCATIONS

(SEE CONNECTION PIPE SIZE CHART)

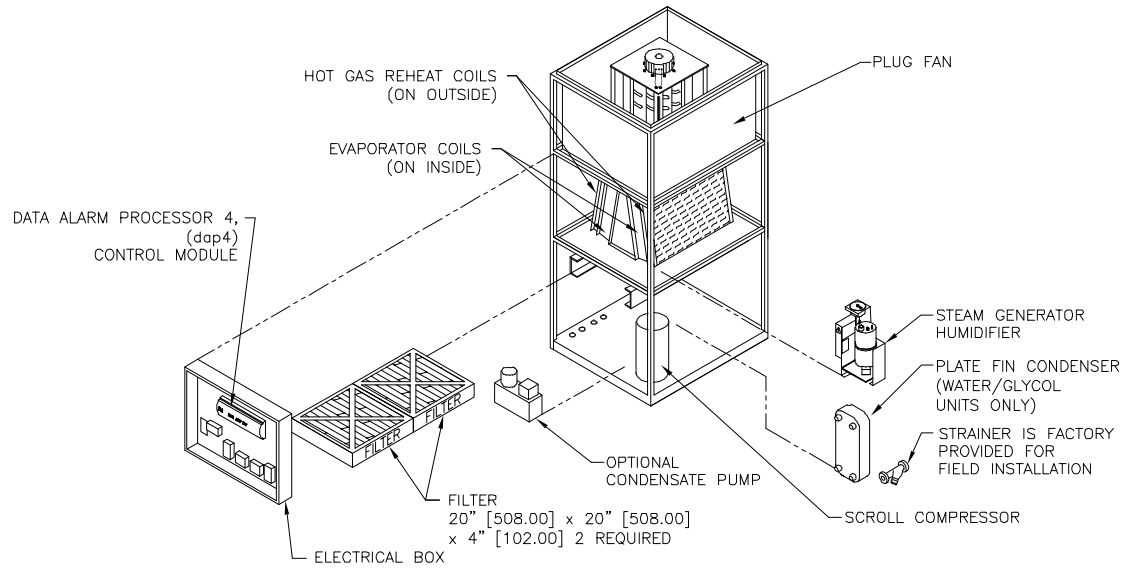

COMPONENT BREAKDOWN

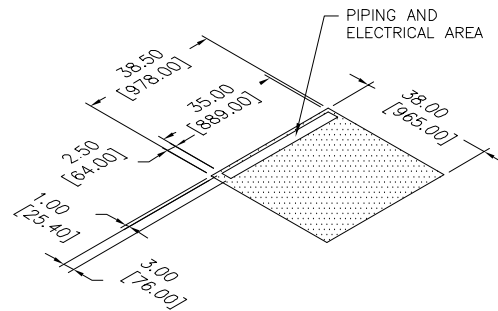

BOTTOM PANEL LAYOUT DIMENSIONS

G-POD FLOOR UNIT
DX UPFLOW
5 TON



DRAWN BY :	RK	SCALE: NONE
CHECKED BY :	SI	SH 1 OF 1
DATE :	04-25-2016	REV C

PART OF

570-900-701
DWG NO.