


NOTES:


- △ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
- 2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
- 3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
- 4. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

CONNECTION PIPE SIZE (Ø)		
LIQUID	1/2	[12.70]
HOT GAS	1/2	[12.70]
WATER IN	1-1/8	[29.00]
WATER OUT	1-1/8	[29.00]


REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
A	UPDATED REAR VIEW	01-21-19	MTC	AD

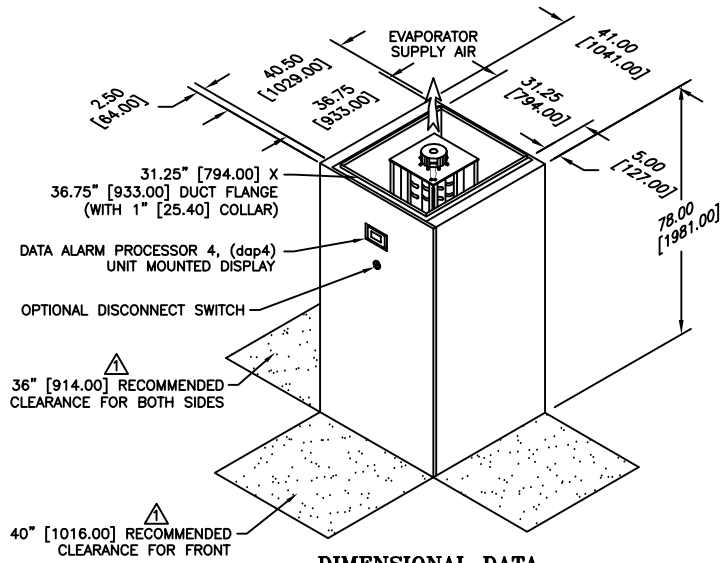


DIMENSIONAL DATA

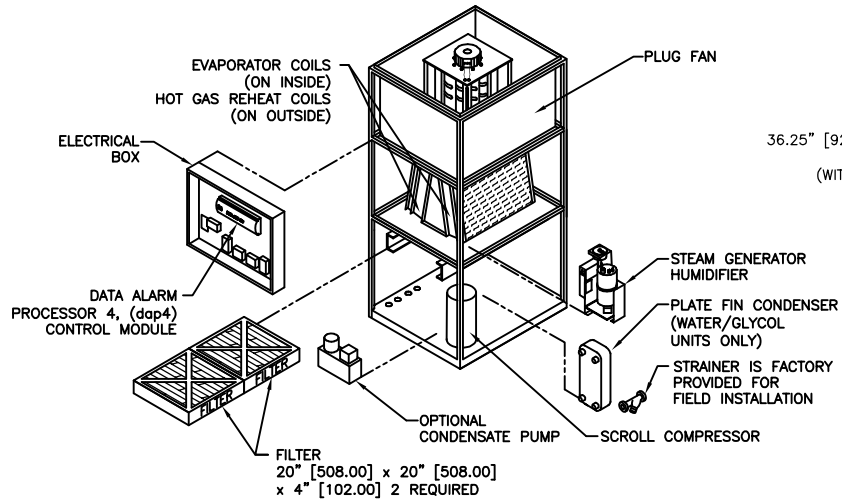


COMPONENT BREAKDOWN

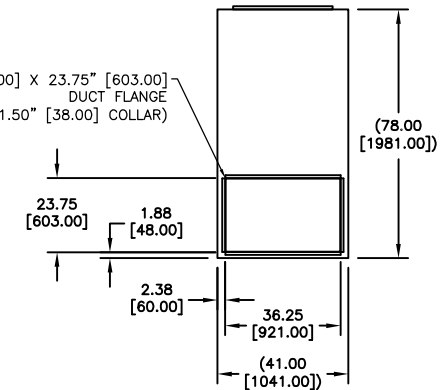

REAR VIEW




WATER/GLYCOL COOLED



AIR COOLED

STANDARD PIPING LOCATIONS

(SEE CONNECTION PIPE SIZE CHART)

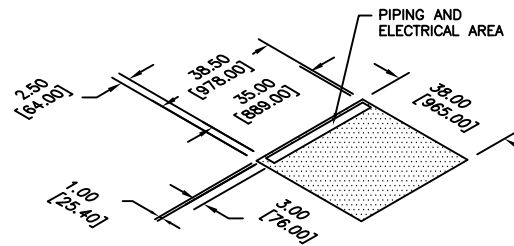

BOTTOM PANEL LAYOUT DIMENSIONS

G-POD FLOOR UNIT
DX UPFLOW 5 TON
WITH REAR RETURN AIR



DRAWN BY : M. COCHRAN	SCALE: NONE
CHECKED BY : A. DELGADO	SH 1 OF 1
DATE : 10-08-2018	REV A

PART OF

570-900-703
DWG NO.