



NOTES:

1. FACTORY RECOMMENDED CLEARANCES ARE 36" [914.00] OF OPEN SPACE AT THE FRONT AND SIDES OF THE UNIT, WHICH ARE MINIMUM CLEARANCES REQUIRED. CONSULT LOCAL BUILDING CODES AND NEC REQUIREMENTS FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

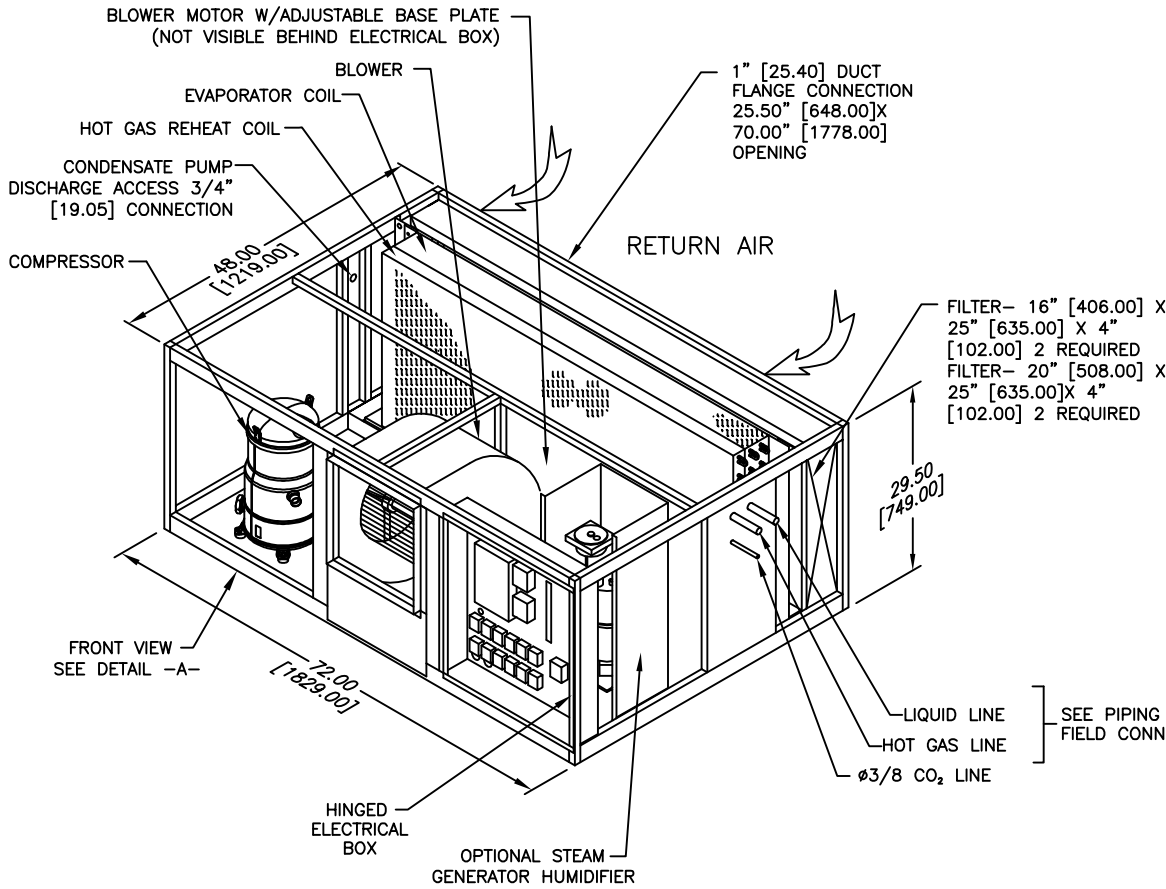

AIR COOLED INDOOR EVAPORATOR
(SHOWN WITHOUT PANELS)

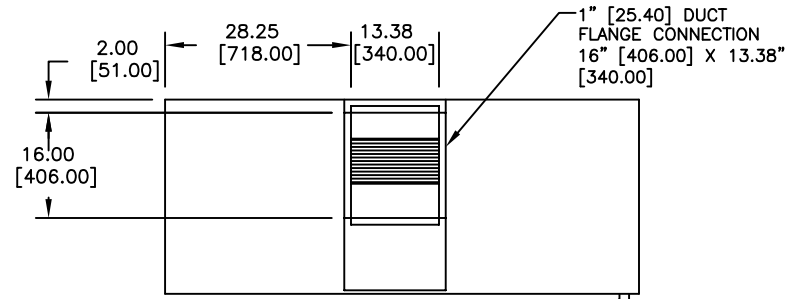

DETAIL -A-
FRONT VIEW

SEE PIPING CHART FOR FIELD CONNECTION SIZES

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
A	UPDATED CO ₂ LINE CALLOUTS	10-11-16	RK	SI

PIPING CHART					
UNIT SIZE	LIQUID LINE		HOT GAS LINE		
6 TON	5/8"	[15.88] O.D.	5/8"	[15.88] O.D.	
8 TON	5/8"	[15.88] O.D.	3/4"	[19.05] O.D.	
10 TON	5/8"	[15.88] O.D.	3/4"	[19.05] O.D.	
13 TON	7/8"	[22.23] O.D.	7/8"	[22.23] O.D.	

G-POD CEILING UNIT
AIR COOLED SPLIT
GPAX-XXXX-CO 6-13 TON

dataaire

DRAWN BY : RRK SCALE: NONE
CHECKED BY : SI SH 1 OF 1
DATE : 04-25-2016 REV A

PART OF
573-900-051
DWG NO.