



NOTES:

1. FACTORY RECOMMENDED CLEARANCES ARE 36" [914.00] OF OPEN SPACE AT THE FRONT AND SIDES OF THE UNIT, WHICH ARE MINIMUM CLEARANCES REQUIRED. CONSULT LOCAL BUILDING CODES AND NEC REQUIREMENTS FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.

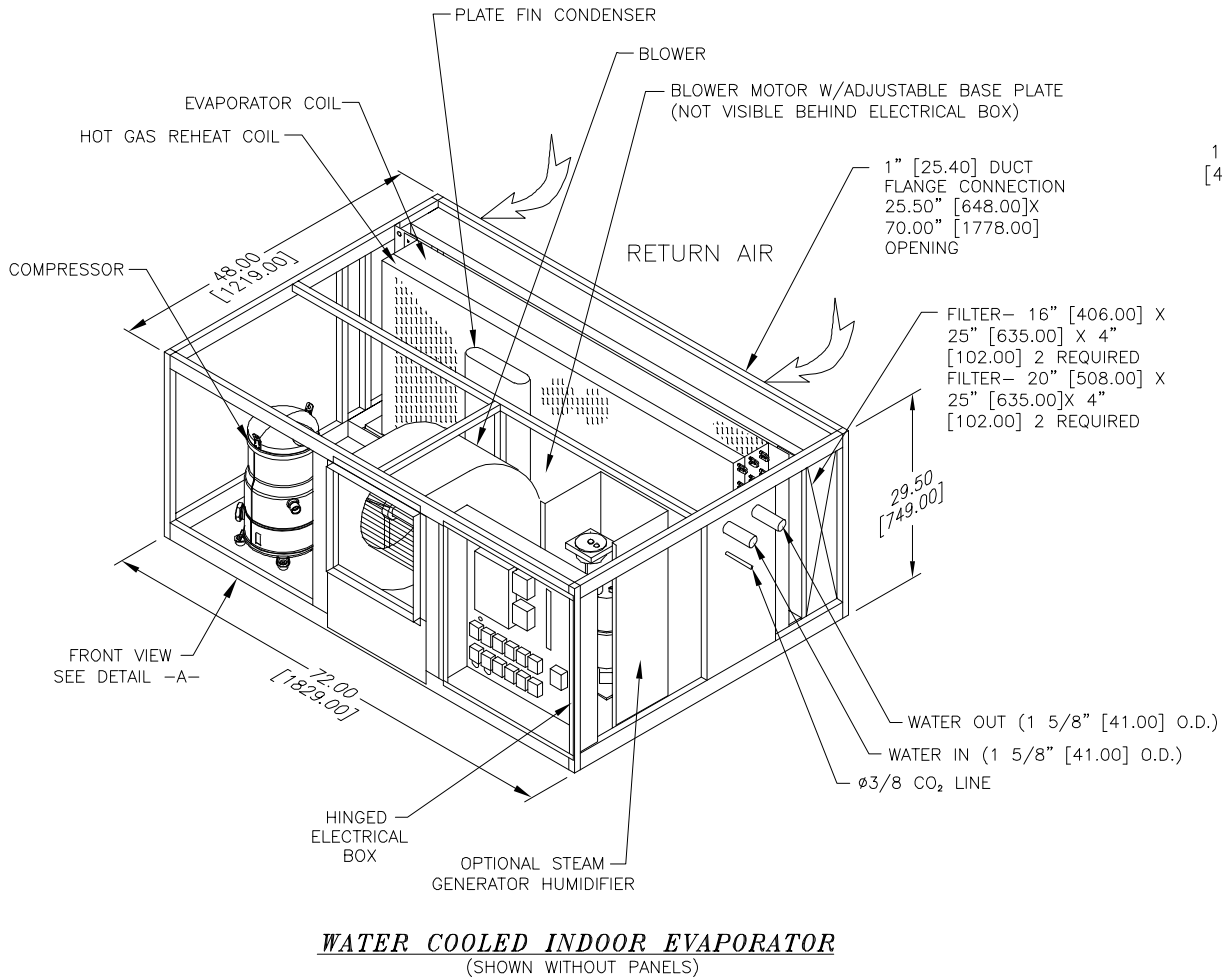

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
D	REMOVED "-P" FROM DRAWING TITLE	11-19-18	MTC	DM

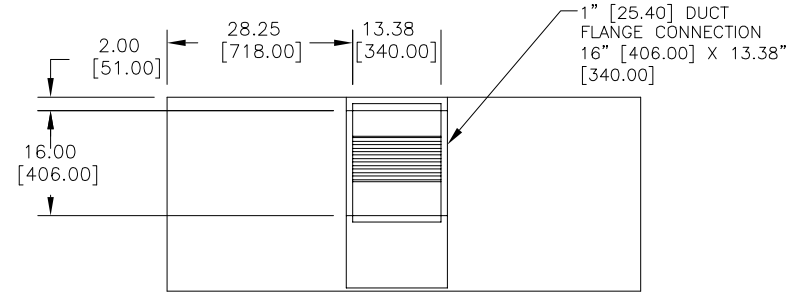

DETAIL -A-
FRONT VIEW

G-POD CEILING UNIT WTR/GLY INDOOR PACKAGE GPW/GX-XXXX 6-13 TON			
dataaire			
DRAWN BY :	RRK	SCALE: NONE	
CHECKED BY :	SI	SH 1 OF 1	
DATE :	04-25-2016	REV	D
PART OF			
573-900-060			
DWG NO.			