

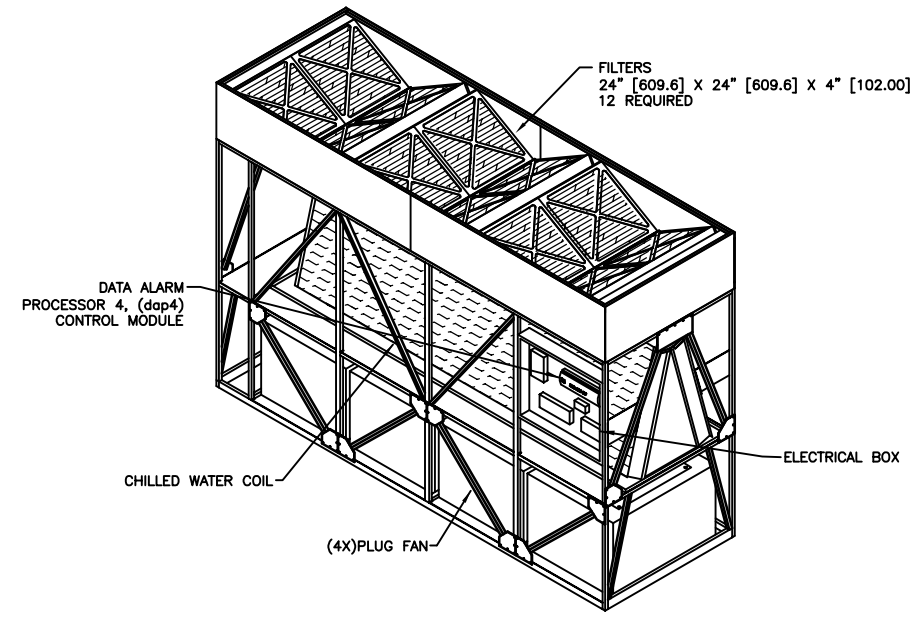


NOTES:


1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL STANDARD PIPING TERMINATES INSIDE OF CABINET. ALL OPTIONAL PIPING (TOP/SIDE) TERMINATES OUTSIDE OF CABINET.
3. NOT ALL COMPONENTS AND OPTIONS ARE SHOWN. LOCATIONS MAY VARY DEPENDING ON OPTIONS.
4. CONNECTION PIPE SIZE IS 3 1/8 [79.00] DIAMETER.
5. ALL DIMENSIONS ARE IN INCH [mm] FORMAT.

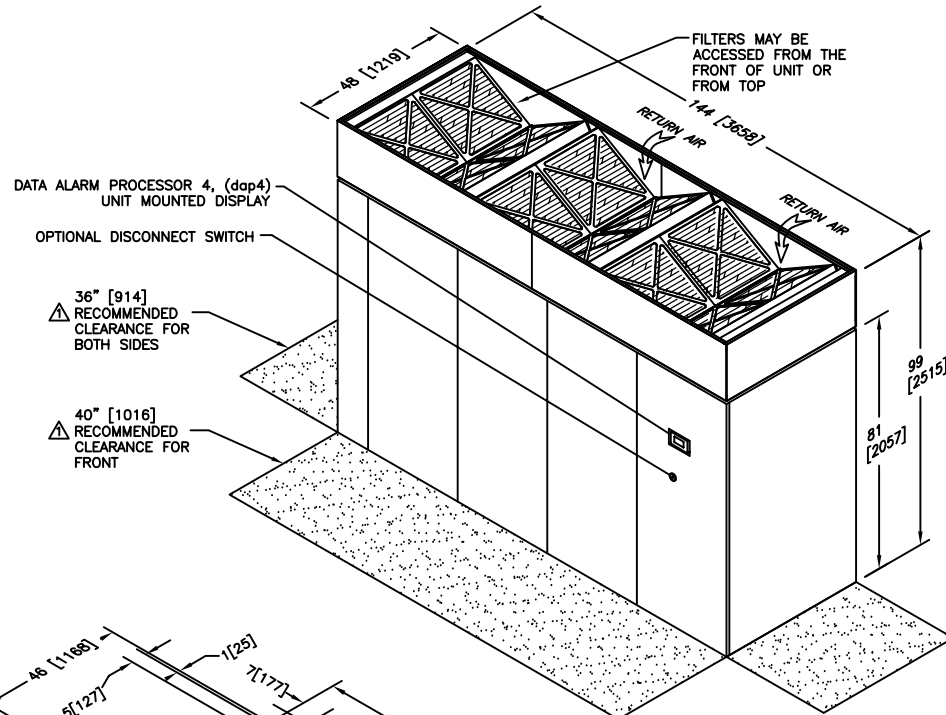

DIMENSIONAL DATA

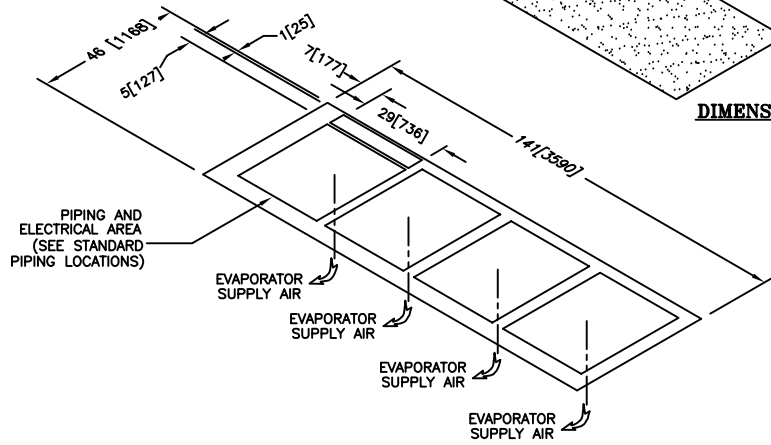

FLOOR CUTOUT DIMENSIONS

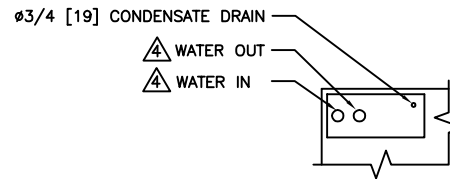

STANDARD PIPING LOCATIONS

gForce GF 375 KW CHILLED WATER DOWNFLOW			
DRAWN BY : DORTEGA		SCALE: NONE	
CHECKED BY : BMOSES		SH 1 OF 1	
DATE : 03-26-2020		REV	-
PART OF			
580-900-375 DWG NO.			