
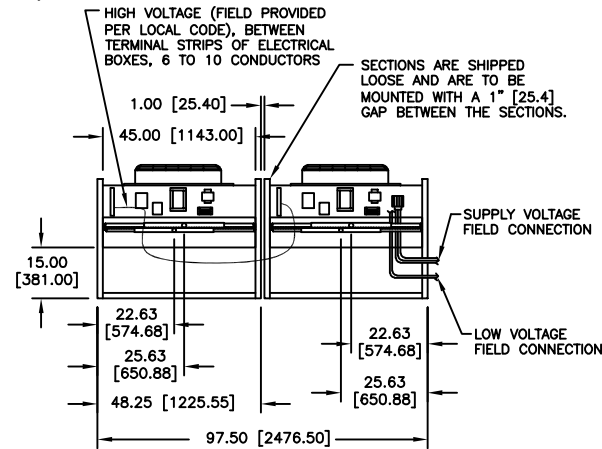
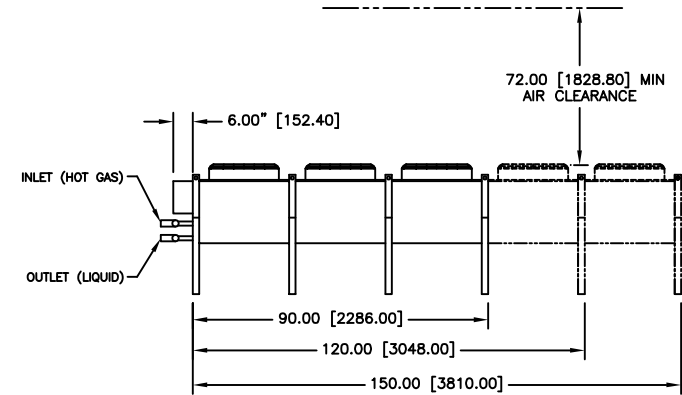
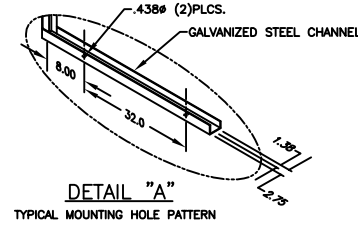


NOTES:

1. ALL UNIT DIMENSIONS ARE IN INCH [mm] FORMAT.
2. A DOUBLE WIDE CONDENSER SHIPS AS TWO EQUALLY SIZED SECTIONS THAT MUST BE MOUNTED SIDE BY SIDE AND RE-CONNECTED UPON INSTALLATION. A SINGLE SOURCE OF LINE VOLTAGE POWER IS REQUIRED. HIGH VOLTAGE WIRING FROM ONE ELECTRICAL BOX TO THE OTHER IS REQUIRED. THE SECTION ON THE RIGHT HAS A COMPLETE ELECTRICAL BOX. THE OTHER HAS AN ELECTRICAL BOX THAT ONLY HAS A TERMINAL BLOCK. WIRING MUST BE FIELD CONNECTED BETWEEN THE ELECTRICAL BOX OF THE RIGHT SECTION TO THE ELECTRICAL BOX ON THE LEFT. REFER TO LOCAL ELECTRICAL CODES.

REVISIONS			
REV	DESCRIPTION	DATE	BY
E	ADDED DETAIL "A"	06-25-21	MC

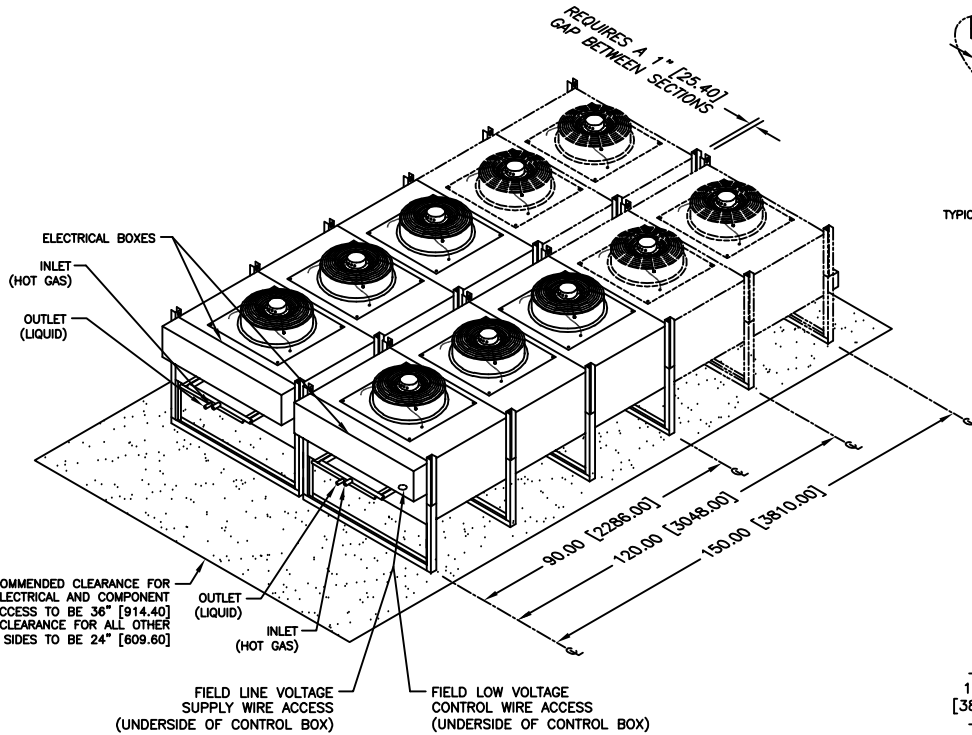

NOTE: UNIT WEIGHT IS AN ESTIMATED UNCRATED WEIGHT.

MODEL NUMBER	LENGTH	UNIT NET WT. #	PIPE CONNECTION SIZES (COPPER STUB, OD)		QTY. MOTORS	STANDARD CONDENSER				
			HOT GAS	LIQUID		KW	RPM	TOTAL CFM	MOTOR FLA 208/230V 460V	
GHRC 201	93" [2362.20]	1466	1-3/8	7/8	6	1.04	VARIABLE	29,500	20	10
GHRC 215	123" [3124.20]	1606	1-3/8	7/8	8	1.04	VARIABLE	39,500	26	14
GHRC 264	123" [3124.20]	1880	1-5/8	1-1/8	8	1.04	VARIABLE	39,000	26	14
GHRC 281	123" [3124.20]	1940	1-5/8	1-1/8	8	1.04	VARIABLE	38,000	26	14
GHRC 310	153" [3886.20]	2200	1-5/8	1-1/8	10	1.04	VARIABLE	49,000	33	17
GHRC 352	153" [3886.20]	2400	1-5/8	1-1/8	10	1.04	VARIABLE	48,000	33	17

GHRC 201-352 KW
DOUBLE WIDE CONDENSER
WITH E/C FANS

dataaire

DRAWN BY : GABE		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE : 10-29-2010	REV	E	

PART OF
600-000-874
DWG NO.