
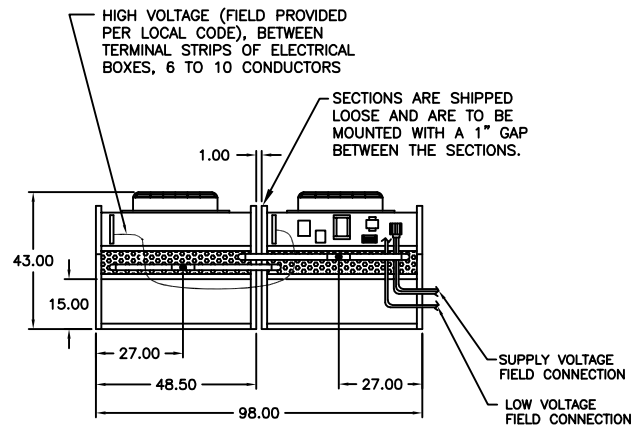
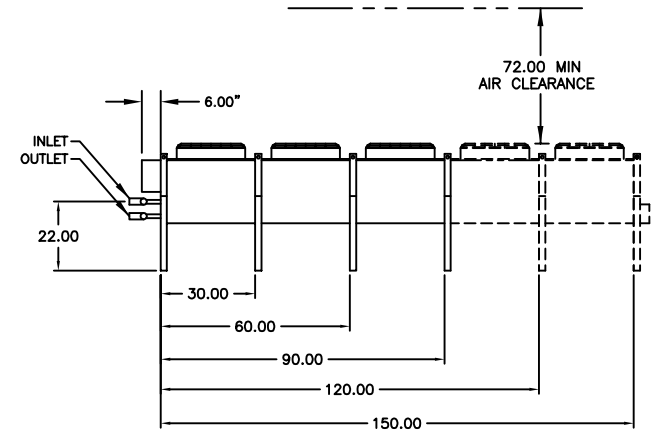


**NOTES:**

1. A DOUBLE WIDE FLUID COOLER SHIPS AS TWO EQUALLY SIZED SECTIONS THAT MUST BE MOUNTED SIDE BY SIDE AND RE-CONNECTED UPON INSTALLATION. A SINGLE SOURCE OF LINE VOLTAGE POWER IS REQUIRED. HIGH VOLTAGE WIRING FROM ONE ELECTRICAL BOX TO THE OTHER IS REQUIRED. THE SECTION ON THE RIGHT HAS A COMPLETE ELECTRICAL BOX. THE OTHER HAS AN ELECTRICAL BOX THAT ONLY HAS A TERMINAL BLOCK. WIRING MUST BE FIELD CONNECTED BETWEEN THE ELECTRICAL BOX OF THE RIGHT SECTION TO THE ELECTRICAL BOX ON THE LEFT. REFER TO LOCAL ELECTRICAL CODES.
2. ALL INLET AND OUTLET PIPE CONNECTION SIZES ARE 2 5/8" WITHOUT MANIFOLD OR 3" WITH MANIFOLD.

REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
D	REVISE TITLEBLOCK WITH NEW DATA AIRE LOGO	03-18-15	JAP	GM

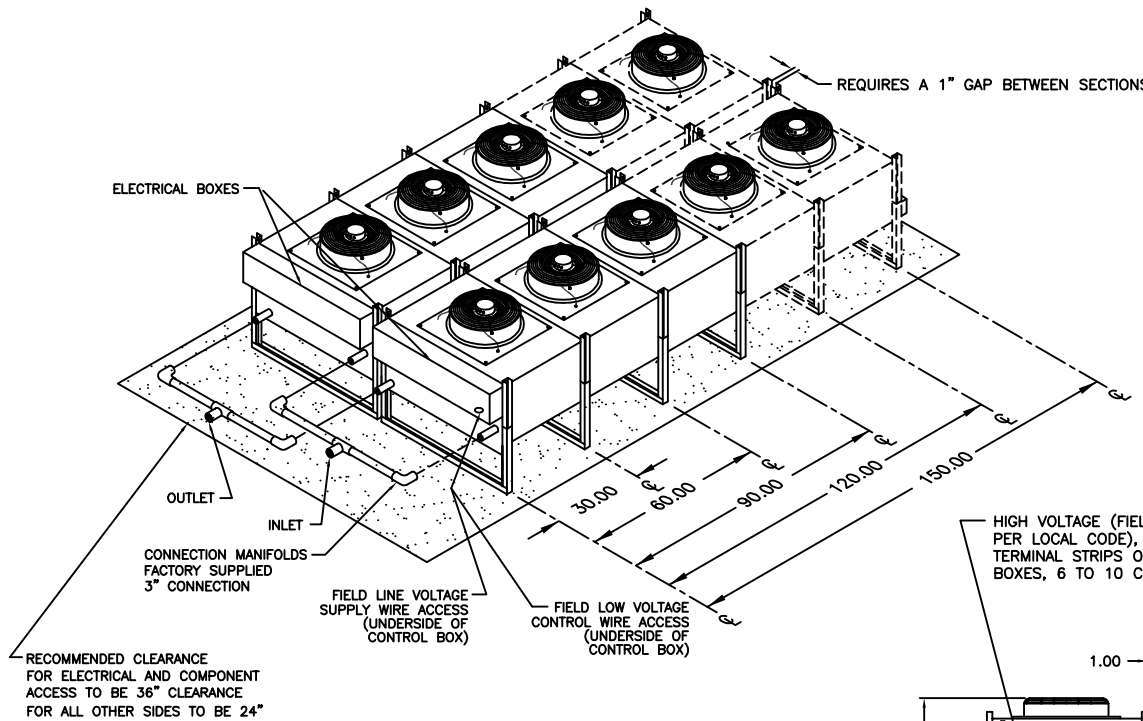

NOTE: UNIT WEIGHT IS AN ESTIMATED UNCRATED WEIGHT.

MODEL NUMBER	LENGTH	UNIT NET WT.#	QTY. MOTORS	STANDARD CONDENSER				
				KW	RPM	TOTAL CFM	MOTOR FLA 208/230V	480V
GHFC 201	92-1/4"	1750	6	1.04	1450	29,500	20	10
GHFC 215	122-1/4"	1800	8	1.04	1450	40,000	26	14
GHFC 264	122-1/4"	1880	8	1.04	1450	39,000	26	14
GHFC 281	122-1/4"	1940	8	1.04	1450	38,000	26	14
GHFC 310	152-1/4"	2200	10	1.04	1450	49,000	33	17
GHFC 352	152-1/4"	2400	10	1.04	1450	48,000	33	17

GHFC 201-352 KW  
DOUBLE WIDE FLUID COOLERS  
WITH E/C FANS

**dataaire**

DRAWN BY : J. PATTON      SCALE: NONE

CHECKED BY :                      SH 1 OF 1

DATE : 11-17-2010      REV      D

PART OF

**600-000-881**  
DWG NO.