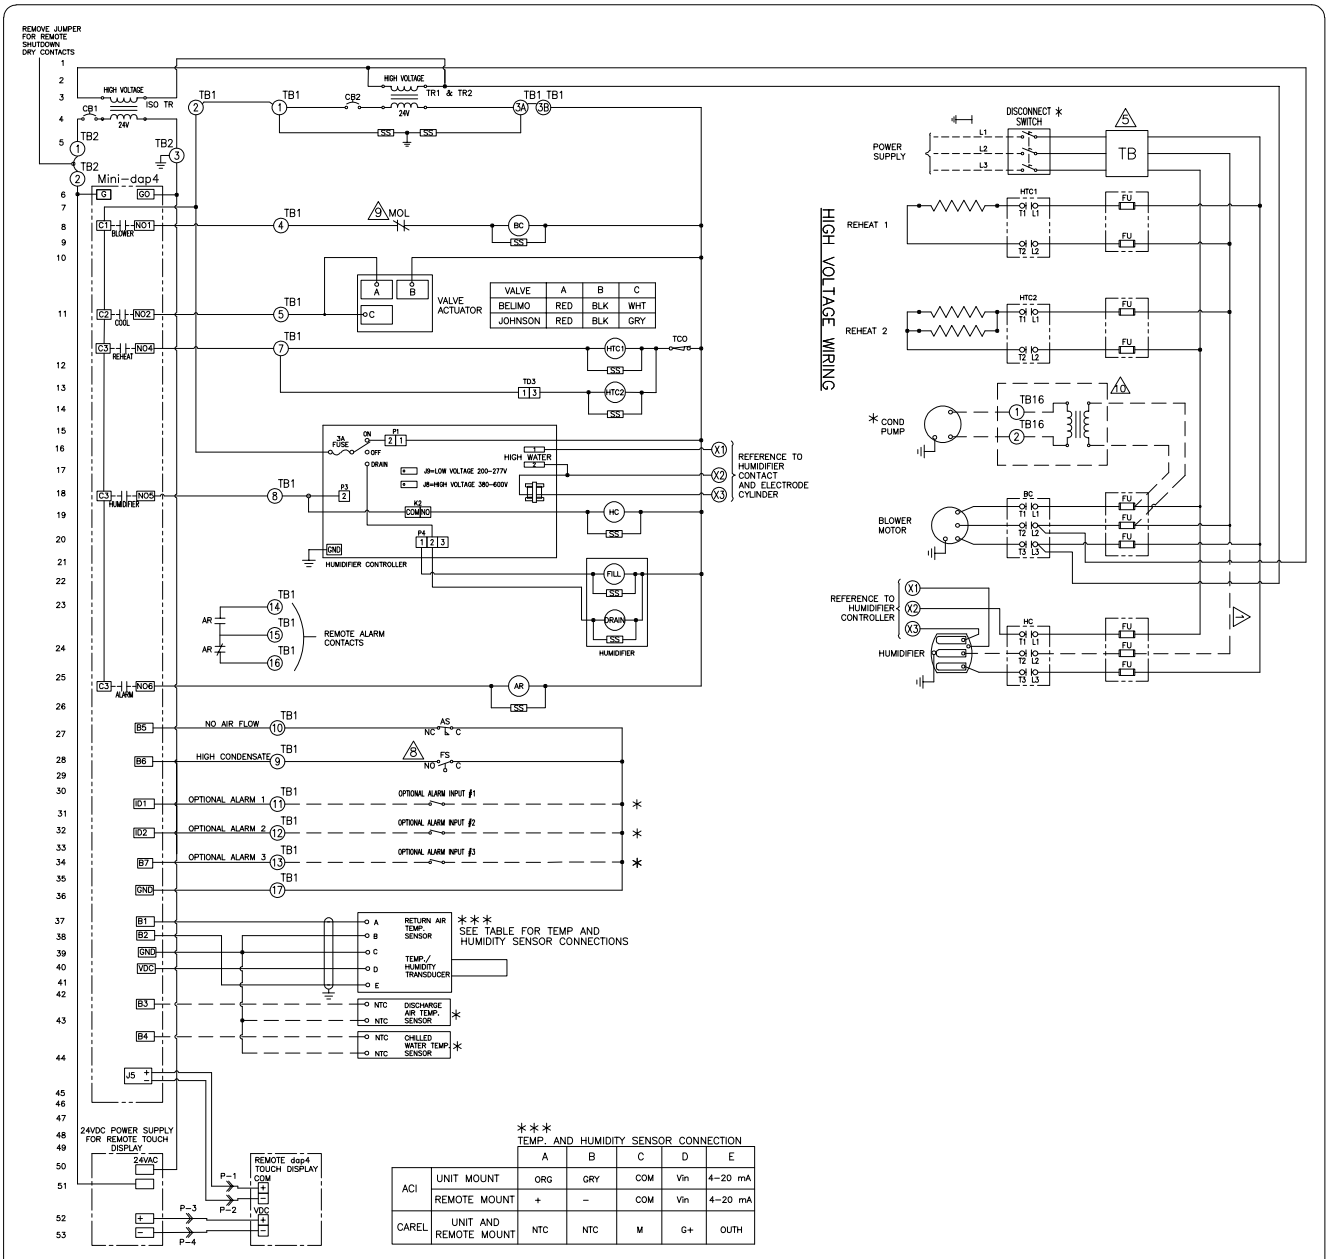

PANEL LEGEND

AR	=	ALARM RELAY
AS	=	AIR FLOW SWITCH
BC	=	BLOWER CONTACTOR
CB	=	CIRCUIT BREAKER
dap4	=	DATA ALARM PROCESSOR 4
FS	=	FLOAT SWITCH
FU	=	HUMIDIFIER CONTACTOR
HC	=	REHEATER CONTACTOR
HTC	=	HIGH WATER SOLENOID
MOL	=	MOTOR OVERLOAD
MVS	=	SURGE SUPPRESSOR
SS	=	TERMINAL BLOCK
TB	=	THERMAL CUTOUT
TCO	=	TIME DELAY
TD	=	TRANSFORMER
TR	=	
	=	TERMINAL BLOCK NO.
	=	OPTIONAL WIRING
	=	FIELD WIRING
*	=	OPTIONAL COMPONENTS
***	=	TEMP. AND HUMIDITY SENSOR CONNECTION TABLE
5	=	USE ON 30 LB. HUMIDIFIER ONLY.
5	=	TB MAY BE OMITTED WHEN DISCONNECT SWITCH IS USED
6	=	THE STANDARD FLOAT SWITCH IN THE DRAIN PAN THAT COMES WITH CEILING UNITS WILL NEED TO BE REMOVED WHEN THE BLUE DIAMOND PUMP OPTION IS SELECTED
10	=	MOL MUST BE WIRED ON THREE PHASE UNITS ONLY
11	=	APPLY ON 277, 460 OR 575V UNITS WITH BLUE DIAMOND PUMP OPTION AND ON 277V UNITS WITH BECKET PUMP

© Copyright 2017 Data Aire, Inc.

dataaire
2300 W. BLUERIDGE AVE. ORANGE, CA. 92865

DWG TITLE:
LARGE CEILING SYSTEM CHILLED WATER WITH MINI-dap4 PANEL

JOB NO:

DRAWN BY: M. COCHRAN

CREATION DATE: 03-30-2017

CHECKED BY: F. BELTRAN

REVISION DATE: 12-04-2020

OPTION:

REVISION: B

DIAGRAM NO:
DAL-S-905 XY