


**NOTES:**


1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.
2. ALL PIPING TERMINATES INSIDE OF CABINET.
3. ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.

REVISIONS			
REV	DESCRIPTION	DATE	BY
D	DELETE ALL DARC-06 REFERENCES	07-23-14	JAP

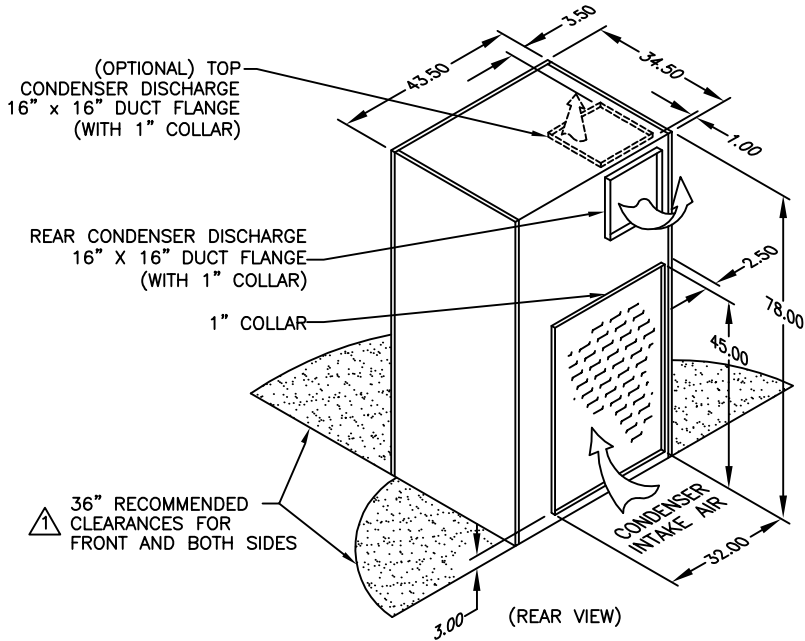


**DIMENSIONAL DATA**

- (OPTIONAL) FILTERS  
 16"X 20"X 4"  
 (1 REQUIRED)  
 20"X 20"X 4"  
 (1 REQUIRED)  
 16"X 25"X 4"  
 (1 REQUIRED)  
 20"X 25"X 4"  
 (1 REQUIRED)

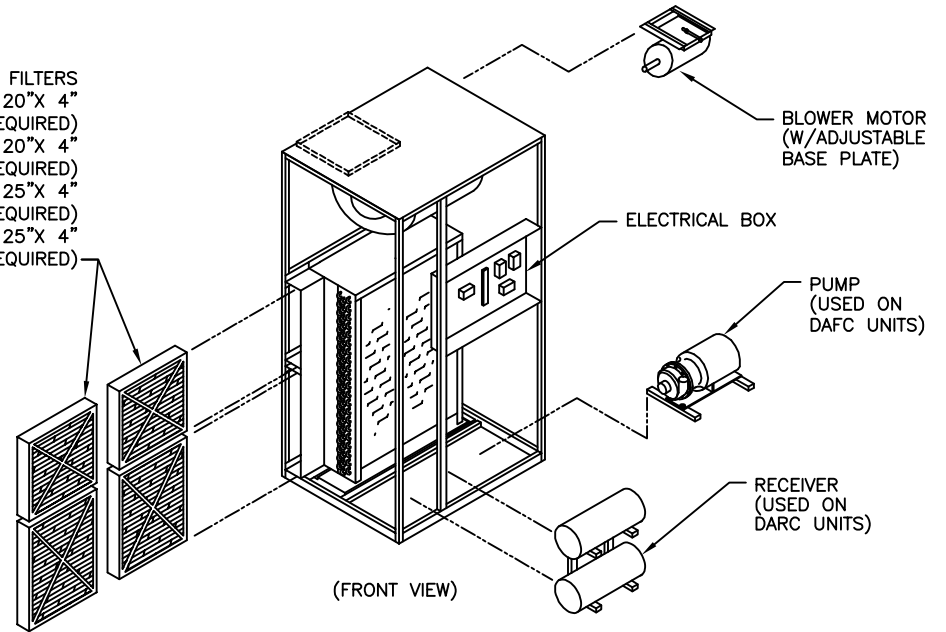

**COMPONENT BREAKDOWN**

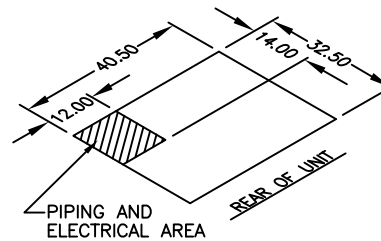

**FLOOR PLAN DIMENSIONS**

DATA AIRE PIGGY BACK  
HEAT EXCHANGER, DARC  
AND DAFC 6, 7, & 9 TON



DRAWN BY : J. HERNANDEZ      SCALE: NONE  
 CHECKED BY :                      SH 1 OF 1  
 DATE : 01-11-2006      REV      D

PART OF

**PB-900-001**  
DWG NO.

MODEL NUMBER	PIPING INLET DIA STUB	PIPING OUTLET DIA STUB	PHYSICAL DATA			ELECTRICAL DATA			
			QTY FANS	TOTAL CFM	UNIT WEIGHT	QTY MOTORS	HP	FLA 208/230V	FLA 460V
DARC 7	1 1/8	7/8	1	4900	820	1	3.0	9.0	4.4
DARC 9	1 1/8	7/8	1	4800	840	1	3.0	9.0	4.4
DAFC 6	1 5/8	1 5/8	1	5000	800	1	3.0	9.0	4.4
DAFC 7	1 5/8	1 5/8	1	4900	820	1	3.0	9.0	4.4
DAFC 9	1 5/8	1 5/8	1	4800	840	1	3.0	9.0	4.4