



NOTES:

- 1. DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS
- 2. ALL PIPING TERMINATES INSIDE OF CABINET.
- 3. ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.


REVISIONS				
REV	DESCRIPTION	DATE	BY	CHKBY
G	UPDATED PIPING SIZES FOR DAFC 17	06-01-21	MC	DM

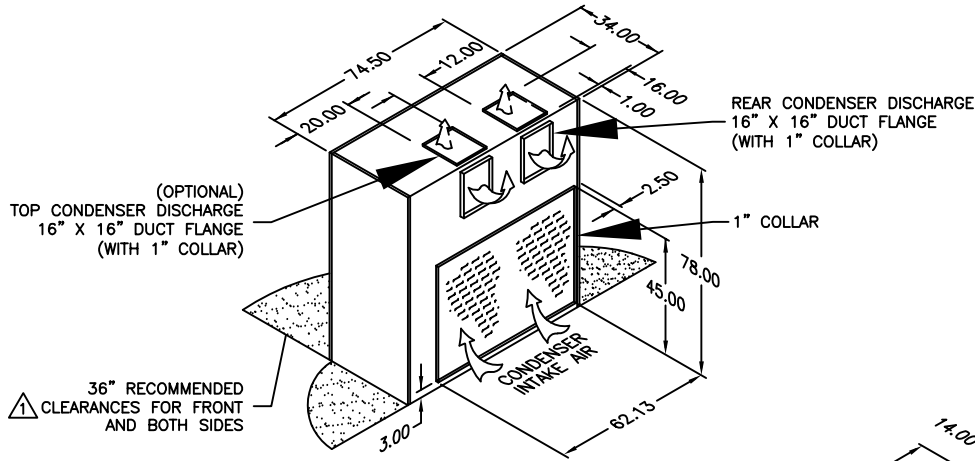

(REAR VIEW)
DIMENSIONAL DATA

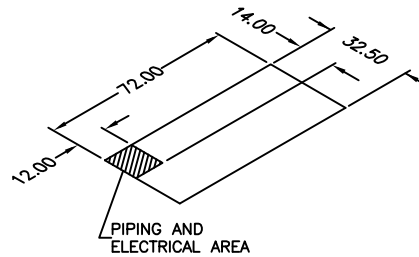

FLOOR PLAN DIMENSIONS

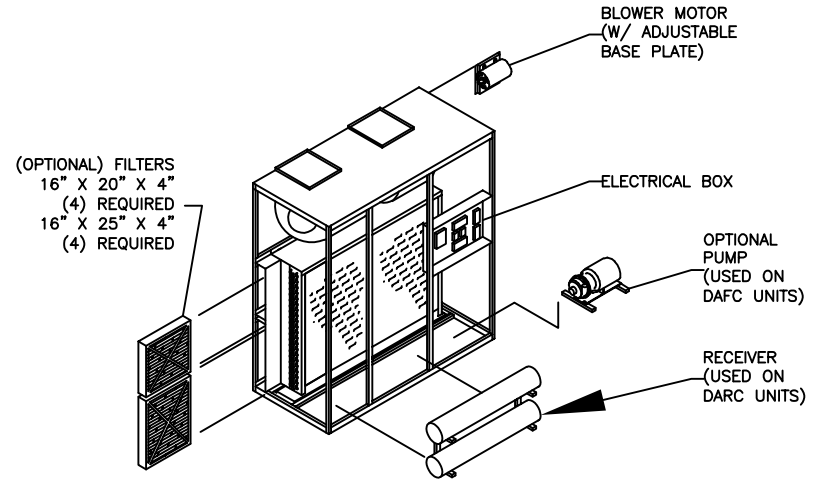

(FRONT VIEW)
COMPONENT BREAKDOWN

MODEL NUMBER	PIPING INLET (DIA STUB)	PIPING OUTLET (DIA STUB)	PHYSICAL DATA			ELECTRICAL DATA			
			QTY FANS	TOTAL CFM	UNIT WEIGHT	QTY MOTORS	HP	FLA 208/230V	FLA 460V
DARC 11	1 1/8	7/8	2	10400	960	1	7.5	23.0	11.0
DARC 15	1 1/8	7/8	2	10000	1110	1	7.5	23.0	11.0
DARC 17	1 1/8	7/8	2	9800	1220	1	7.5	23.0	11.0
DAFC 11	2 1/8	2 1/8	2	10400	960	1	7.5	23.0	11.0
DAFC 15	2 1/8	2 1/8	2	10000	1110	1	7.5	23.0	11.0
DAFC 17	2 5/8	2 5/8	2	9800	1220	1	7.5	23.0	11.0

DATA AIRE PIGGY BACK
HEAT EXCHANGER
DARC & DAFC 11,15, & 17 TON



DRAWN BY : PIZZO, J SCALE: NONE
CHECKED BY : - SH 1 OF 1
DATE : 07-14-1998 REV G

PART OF

PB-900-002
DWG NO.