


**NOTES:**

△ DIMENSIONS NOTED ARE THE MINIMUM CLEARANCES REQUIRED BY THE FACTORY. CONSULT LOCAL BUILDING CODES AND NEC FOR ADDITIONAL CLEARANCE REQUIREMENTS.


- ALL PIPING TERMINATES INSIDE OF CABINET.
- ALL COMPONENTS AND OPTIONS ARE NOT SHOWN.

REVISIONS				
REV	DESCRIPTION	DATE	BY	FROM
F	UPDATED PIPING SIZES FOR DAFC 24 & 28	06-01-21	MC	DM

***DATA AIRE PIGGY BACK HEAT EXCHANGER  
DARC AND DAFC 21, 24 & 28 TON***

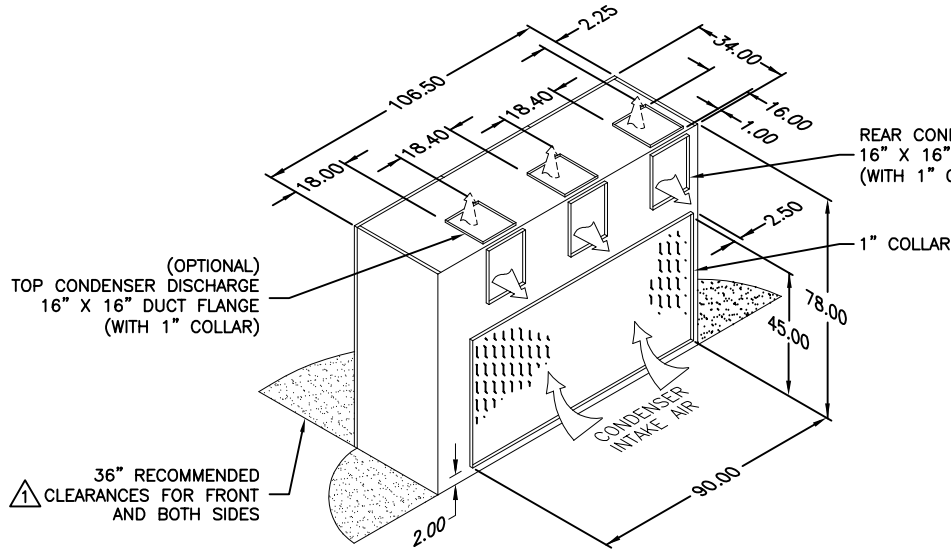


(REAR VIEW)  
**DIMENSIONAL DATA**

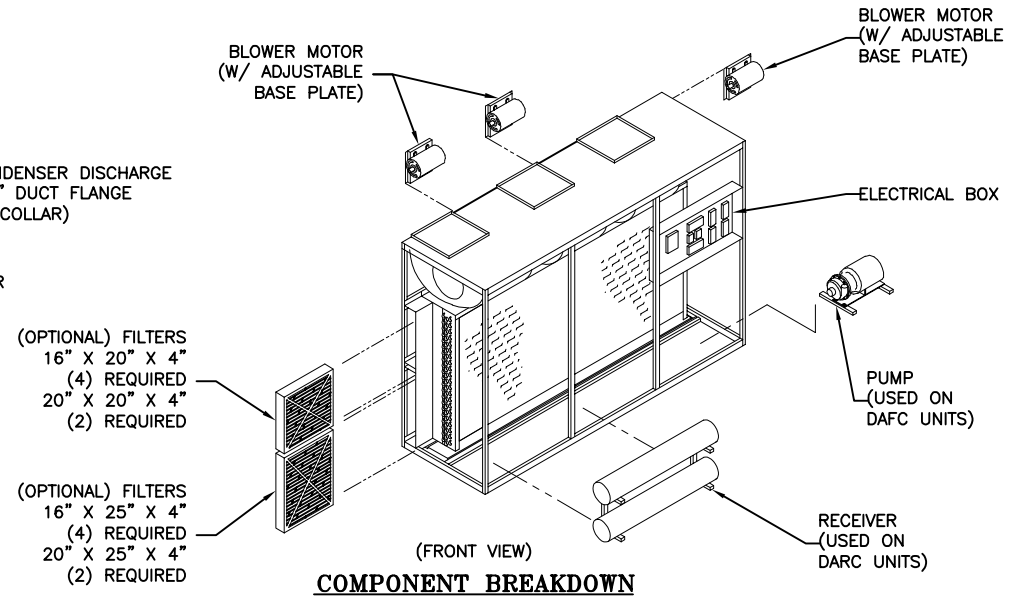

(FRONT VIEW)  
**COMPONENT BREAKDOWN**

MODEL NUMBER	PIPING INLET (DIA STUB)	PIPING OUTLET (DIA STUB)	PHYSICAL DATA			ELECTRICAL DATA			
			QTY FANS	TOTAL CFM	UNIT WEIGHT	QTY MOTORS	HP	FLA 208/230V	FLA 460V
DARC 21	1 1/8	7/8	3	15000	1400	3	3	27.0	13.2
DARC 24	1 1/8	7/8	3	14750	1500	3	3	27.0	13.2
DARC 28	1 1/8	7/8	3	14500	1600	3	3	27.0	13.2
DAFC 21	2 1/8	2 1/8	3	15000	1440	3	3	27.0	13.2
DAFC 24	2 5/8	2 5/8	3	14750	1540	3	3	27.0	13.2
DAFC 28	2 5/8	2 5/8	3	14500	1640	3	3	27.0	13.2

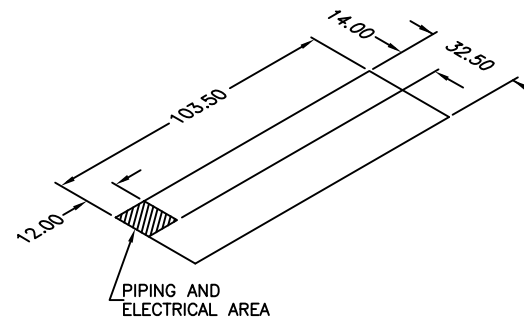

**FLOOR PLAN DIMENSIONS**

DATA AIRE PIGGY BACK  
HEAT EXCHANGER  
21, 24, & 28 TON DARC & DAFC UNITS

**dataaire**

DRAWN BY : J. PIZZO		SCALE: NONE	
CHECKED BY :		SH 1 OF 1	
DATE :	03-24-98	REV	F
PART OF			
<b>PB-900-003</b>			
DWG NO.			